



- Seismic Zone Qualification
- Tension Zone
- Cracked Concrete



ICC-ES 3981

ESR-3981 - LABC - LARC
ESR-3981 - CBC - CRC
ESR-3981 - FBC

MIAMI-DADE COUNTY
APPROVED

NOA 18-0403.04



**BRIGHTON-BEST
INTERNATIONAL**

www.brightonBEST.com | 1-800-275-0050

U.S. ANCHOR PRODUCTS are manufactured to the highest standards for construction and industrial applications. Our flagship ULTRAWEDGE™+ is manufactured from 1035 cold rolled steel.

It earned the coveted ICC-ES approval (ESR #3981) for cracked and un-cracked concrete. The Ultrawedge™+ anchor is approved by Miami-Dade County, Florida Building Code, Los Angeles Building and Residential Codes and California Building and Residential Codes.

The U.S. ANCHOR LINE includes a full line of light/ medium and heavy duty selections. This broad offering is backed up by a strong inventory commitment via 20+ national warehouses and a trained inside and outside salesforce. Additional testing of our products is ongoing with our in-house QC department as well as bi-annual ICC-ES supervised audits at our Ultrawedge™+ factory.

ANCHOR PRODUCT LINES

WEDGE ANCHORS ULTRAWEDGE™+

- Carbon Steel (BBI# 157)
- Hot Dipped Galvanized (BBI# 158)
- Acoustical (BBI# 279)
- Stainless Steel 304 (BBI# 616)
- Stainless Steel 316 (BBI# 617)

WEDGE ANCHORS

- Carbon Steel (Bulk) (BBI# 279)

SLEEVE ANCHORS

- Acorn Nut Carbon Steel (BBI# 276)
- Hex Nut Carbon Steel (BBI# 278)
- Flat Head Carbon Steel (BBI# 277)
- Round Head Carbon (BBI# 426)
- Hex Nut 303 Stainless (BBI# 618)

SLEEVE ANCHORS ROD HANGER TYPE

- Carbon Steel (BBI# R17)

DROP-IN ANCHORS

- Carbon Steel-US Anchor (BBI# 268)
- Carbon Steel-Shorty Version (BBI# 268)
- Carbon Steel-Commercial (Bulk) (BBI# 269)
- Carbon Steel-Commercial Shorty Version (BBI# 269)
- 304 Stainless-US Anchor (BBI# 618)

MACHINE SCREW ANCHORS

- Setting Tools (BBI# R06)

TAP-KING CONCRETE SCREWS HEX & FLAT HEAD RUSTPERT COATING (Pkg) (BBI# 660)

CONCRETE SCREWS (Bulk)

- Commercial Hex & Flat Head (BBI# 685)

DRILL BITS (SDS, STRAIGHT) FOR CONCRETE SCREWS (BBI# R62)

TOGGLE BOLTS

- Zinc (BBI# 893)
- Acoustical Zinc (BBI# 143)

TOGGLE WINGS (BBI# 262)

HAMMER DRIVE ANCHORS

- Mushroom Head with Zinc Nails (BBI# 266)
- Mushroom Head with 304 Nails (BBI# 265)

HOLLOW WALL ANCHORS

- Combo (Phil/Slot) Pan (BBI# 267)
- Drive Anchor Combo (Phil/Slot) Pan (BBI# 272)
- Setting Tool (BBI# R05)

LAG SCREW EXPANSION SHIELDS

- Short Zinc Alloy (BBI# 273)
- Long Zinc Alloy (BBI# 274)

SINGLE EXPANSION SHIELDS (BBI# 264)

DOUBLE EXPANSION SHIELDS (BBI# 263)

SPLIT FAST ANCHOR (Flat & Round Head) (BBI# 159)

CONICAL PLASTIC ANCHORS (BBI# 078)

CONICAL PLASTIC ANCHOR KIT (BBI# 079)

NYLON NAIL ANCHORS (BBI# R14)

EYECOUPINGS (BBI# R37)

MUNGO

- Nylon Plug (BBI# 156 / R12)
- Universal Plug (BBI# R13)
- Jet Plug Kits (BBI# R11)

FRAMING ANCHORS (BBI# R08)

HAMMER SCREWS (BBI# R10)

L SHAPED ANCHOR BOLT WITH NUT & WASHER HDG (BBI# 432)

WOOD SCREW ANCHOR LEAD ALLOY (BBI# 280)

PROFERRED® CARBIDE (BBI# C10)

- SDS+
- SDS Max
- Straight Shank
- Concrete Screw Bits
- Specialty Bits

TABLE OF CONTENTS

- 1** **Ultrawedge™+ Wedge Anchors**
- 2** **Sleeve Anchors** - Acorn Head, Flat Head, Hex Nut Head, Round Head and Rod Hanger
- 3** **Tapking™ Concrete Screws** - NOA 19.0326.03
- 4** **Drop In - Flush & Mini Version**
- 5** **ICC-ES ESR #3981** - Ultrawedge™+ Wedge Anchors Cracked and Un-Cracked Concrete
- 11** **City of Los Angeles - State of California** - Ultrawedge™+ Wedge Anchors Cracked and Un-Cracked Concrete
- 12** **State of Florida Building Code** - Ultrawedge™+ Wedge Anchors Cracked and Un-Cracked Concrete
- 13** **Miami-Dade County Approval** - NOA 18-0403.04 - Ultrawedge™ Anchors - Cracked and Un-Cracked Concrete
- 21** **Miami-Dade County Approval** - NOA 19-0326.03 - Tapking™ SD
- 24** **Engineering Data Sheet (ASD)** Allowable stress loads for anchorage in normal weight concrete
- 27** **Proferred® Carbide Program** - SDS+ - SDS MAX - Straight Shank - Specialty Carbide - Installation Kit



ULTRAWEDGE™ ANCHOR

ULTRAWEDGE™ + CRACKED CONCRETE APPROVED

Part #	Size
157060	3/8"-X2 1/4"
157070	3/8"-X2 3/4"
157080	3/8"-16X3"
157090	3/8"-16X3 3/4"
157100	3/8"-16X5"
157110	3/8"-16X6 1/2"
157180	1/2"-X2 3/4"
157190	1/2"-13X3 3/4"
157200	1/2"-13X4 1/4"
157210	1/2"-13X4 1/2"
157220	1/2"-13X5 1/2"
157230	1/2"-13X7"
157240	1/2"-13X8 1/2"
157250	1/2"-13X10"
157260	1/2"-13X12"
157300	5/8"-X3 1/2"
157310	5/8"-11X4 1/2"
157320	5/8"-11X5"
157330	5/8"-11X6"
157340	5/8"-11X7"
157350	5/8"-11X8 1/2"
157360	5/8"-11X10"
157370	5/8"-11X12"
157380	3/4"-10X4 1/4"
157390	3/4"-10X4 3/4"
157400	3/4"-10X5 1/2"
157410	3/4"-10X6 1/4"
157420	3/4"-10X7"
157430	3/4"-10X8 1/2"
157440	3/4"-10X10"
157450	3/4"-10X12"

ULTRAWEDGE™ 304 STAINLESS

Part #	Size
616010	1/4"-20X1 3/4"
616020	1/4"-20X2 1/4"
616030	1/4"-20X3 1/4"
616040	3/8"-16X2 1/4"
616050	3/8"-16X2 3/4"
616060	3/8"-16X3"
616070	3/8"-16X3 3/4"
616080	3/8"-16X5"
616090	3/8"-16X6 1/2"
616100	1/2"-13X2 3/4"
616110	1/2"-13X3 3/4"
616120	1/2"-13X4 1/4"
616130	1/2"-13X5 1/2"
616140	1/2"-13X7"
616150	1/2"-13X8 1/2"
616160	1/2"-13X10"
616170	1/2"-13X12"
616180	5/8"-11X3 1/2"
616190	5/8"-11X4 1/2"
616200	5/8"-11X5"
616210	5/8"-11X6"
616220	5/8"-11X7"
616230	5/8"-11X8 1/2"
616240	5/8"-11X10"
616250	5/8"-11X12"
616260	3/4"-10X4 1/4"
616270	3/4"-10X4 3/4"
616280	3/4"-10X5 1/2"
616290	3/4"-10X7"
616300	3/4"-10X8 1/2"
616310	3/4"-10X10"
616320	3/4"-10X12"
616330	3/4"-10X6 1/4"
616340	7/8"-9X6"
616350	7/8"-9X8"
616360	1"-8X6"
616370	1"-8X9"
616380	1"-8X12"


ULTRAWEDGE™ 316 STAINLESS

Part #	Size
617010	1/4"-20X1 3/4"
617020	1/4"-20X2 1/4"
617030	1/4"-20X3 1/4"
617040	3/8"-16X2 3/4"
617050	3/8"-16X3"
617060	3/8"-16X3 3/4"
617070	3/8"-16X5"
617080	1/2"-13X2 3/4"
617090	1/2"-13X3 3/4"
617100	1/2"-13X4 1/4"
617110	1/2"-13X5 1/2"
617120	1/2"-13X7"
617130	5/8"-11X3 1/2"
617140	5/8"-11X4 1/2"
617150	5/8"-11X5"
617160	5/8"-11X6"
617170	5/8"-11X7"
617180	5/8"-11X8 1/2"
617190	3/4"-10X4 1/4"
617200	3/4"-10X4 3/4"
617210	3/4"-10X5 1/2"
617220	3/4"-10X6 1/4"
617230	3/4"-10X7"
617240	3/4"-10X8 1/2"

ULTRAWEDGE™ HOT DIP GALV.

Part #	Size
158010	3/8"-16X3 1/2"
158100	1/2"-13X2 3/4"
158110	1/2"-13X3 3/4"
158120	1/2"-13X4 1/4"
158130	1/2"-13X5 1/2"
158140	1/2"-13X7"
158150	1/2"-13X8 1/2"
158160	1/2"-13X10"
158200	5/8"-11X3 1/2"
158210	5/8"-11X5"
158220	5/8"-11X6"
158230	5/8"-11X7"
158240	5/8"-11X8 1/2"
158250	5/8"-11X10"
158300	3/4"-10X4 3/4"
158310	3/4"-10X5 1/2"
158320	3/4"-10X6 1/4"
158330	3/4"-10X8 1/2"
158340	3/4"-10X10"
158400	7/8"-9X6"
158410	7/8"-9X8"
158500	1"-8X6"
158510	1"-8X9"

The newly improved Ultrawedge™+ anchor has been designed for heavy duty applications with impressive performance characteristics. The advanced design of the collar allows for anchoring in the most demanding requirements.

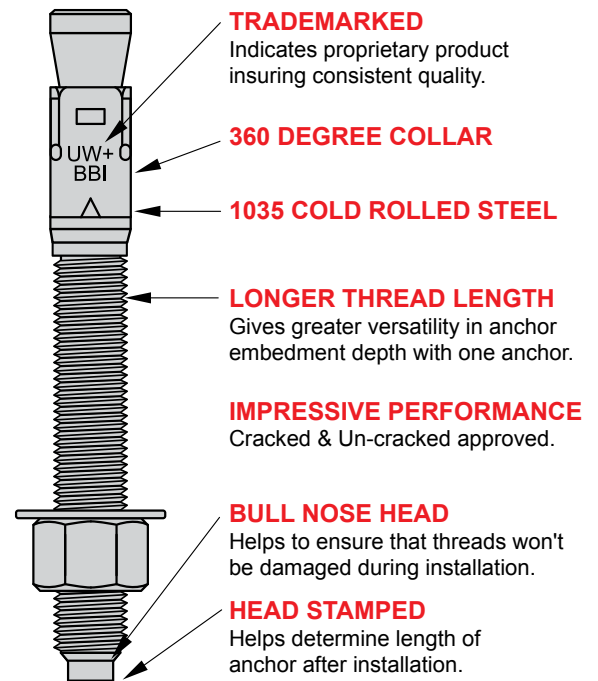

Select anchor length to achieve minimum embedment which will depend on the thickness of the fixture being attached.

(SEE ESR# 3981 REPORT FOR MINIMUM EMBEDMENTS & OTHER REQUIREMENTS)



ESR-3981 - LABC - LARC
ESR-3981 - CBC - CRC
ESR-3981 - FBC

MIAMI-DADE COUNTY
APPROVED
NOA 18-0403.04



SLEEVE ANCHOR

MEDIUM DUTY SLEEVE ANCHOR PROGRAM



SLEEVE ANCHOR - ACORN HEAD

Part #	Pack	VD	Size
276015	100PCS	PR	1/4"-20 X 7/8"
276020	100PCS	PR	1/4"-20 X 1 3/8"
276030	100PCS	PR	1/4"-20 X 2 1/4"



SLEEVE ANCHOR - HEX NUT

Part #	Pack	VD	Size
278030	100PCS	PR	5/16" X 1 1/2"
278040	100PCS	PR	5/16" X 2 1/2"
278050	50PCS	PR	3/8" X 1 7/8"
278060	50PCS	PR	3/8" X 3"
278070	50PCS	PR	3/8" X 4"
278080	25PCS	PR	1/2" X 2 1/4"
278090	25PCS	PR	1/2" X 3"
278100	25PCS	PR	1/2" X 4"
278110	25PCS	PR	1/2" X 6"
278120	25PCS	PR	5/8" X 2 1/4"
278130	25PCS	PR	5/8" X 3"
278135	10PCS	PR	5/8" X 3 7/8"
278140	10PCS	PR	5/8" X 4 1/4"
278150	10PCS	PR	5/8" X 6"
278160	10PCS	PR	3/4" X 2 1/2"
278180	5PCS	PR	3/4" X 4 1/4"
278190	5PCS	PR	3/4" X 6 1/4"



SLEEVE ANCHOR - FLAT HEAD

Part #	Pack	VD	Size
277220	100PCS	PR	1/4" X 2" Threshold



SLEEVE ANCHOR - ROUND HEAD COMBO

Part #	Pack	VD	Size
426005	100PCS	PR	1/4" X 1 1/4"




SLEEVE ANCHOR - ROUND HEAD

Part #	Pack	VD	Size
426010	100PCS	PR	1/4" X 2"
426022	100PCS	PR	1/4" X 2 3/4"
426020	50PCS	PR	3/8" X 2 1/2"
426030	50PCS	PR	3/8" X 3 3/4"
426040	50PCS	PR	3/8" X 4 3/4"



SLEEVE TYPE ROD HANGERS

Part #	Pack	VD	Size
R17003	50PCS	PR	5/16" X 1 1/2"
R17002	50PCS	PR	3/8" X 1 7/8"
R17001	25PCS	PR	1/2" X 2 1/4"
R17004	20PCS	PR	5/8" X 2 1/4"

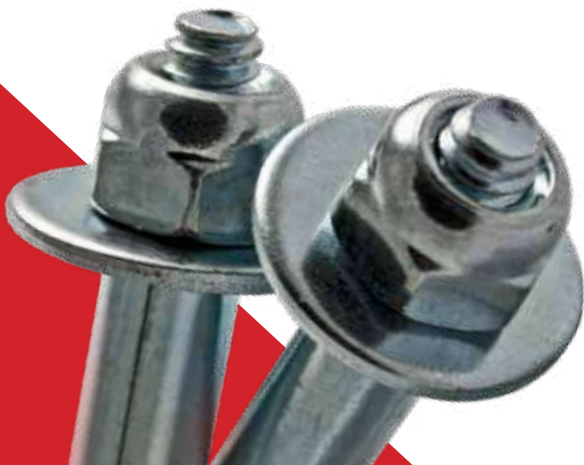



TAPKING™

STANDARD TAPKING™ CONCRETE SCREWS



TAPKING™ CONCRETE SCREWS - HEX HEAD

Part #	Size
660010	3/16" X 1 1/4"
660015	3/16" X 1 3/4"
660020	3/16" X 2 1/4"
660025	3/16" X 2 3/4"
660030	3/16" X 3 1/4"
660035	3/16" X 4"
660050	1/4" X 1 1/4"
660055	1/4" X 1 3/4"
660060	1/4" X 2 1/4"
660070	1/4" X 2 3/4"
660080	1/4" X 3 1/4"
660090	1/4" X 4"
660100	1/4" X 5"
660110	1/4" X 6"



TAPKING™ CONCRETE SCREWS - FLAT HEAD

Part #	Size
660200	3/16" X 1 1/4"
660210	3/16" X 1 3/4"
660220	3/16" X 2 1/4"
660230	3/16" X 2 3/4"
660240	3/16" X 3 1/4"
660250	3/16" X 4"
660260	1/4" X 1 1/4"
660270	1/4" X 1 3/4"
660280	1/4" X 2 1/4"
660290	1/4" X 2 3/4"
660300	1/4" X 3 1/4"
660310	1/4" X 4"
660320	1/4" X 5"
660330	1/4" X 6"

SUITABLE FOR STANDARD CONCRETE BITS AND SDS-HEX ROTARY HAMMER DRILL BITS

Concrete Screw	Length	Drill Bit	Part#
3/16"	1-1/4", 1-3/4"	5/32" x 3-1/2"	R62004
3/16"	2-1/4", 2-3/4"	5/32" x 4-1/2"	R62005
3/16"	3-1/4", 3-3/4", 4"	5/32" x 5-1/2"	R62006
1/4"	1-1/4", 1-3/4"	3/16" x 3-1/2"	R62008
1/4"	2-1/4", 2-3/4"	3/16" x 4-1/2"	R62003
1/4"	3-1/4", 3-3/4", 4"	3/16" x 5-1/2"	R62001
1/4"	5"	3/16" x 6-3/4"	R62002

To Insert Drill Bit


Loosen set screw on side of drill adapter with 1/8" hex key. Do not remove completely. Align flat side of concrete drill bit with set screw and tighten screw.

To Drill

Place drill adapter into 3/8" or 1/2" chuck of standard hammer drill. Place drill bit in drill adapter and tighten set screw. Drill hole minimum of 1/4" deeper than TAPKING™ anchor or concrete screw is to be embedded.

To Drive

Slide sleeve over drill bit and snap onto drill adapter. Snap proper socket into end of sleeve. Insert head of TAPKING™ anchor or concrete screw into socket. Drive until anchor is fully embedded.

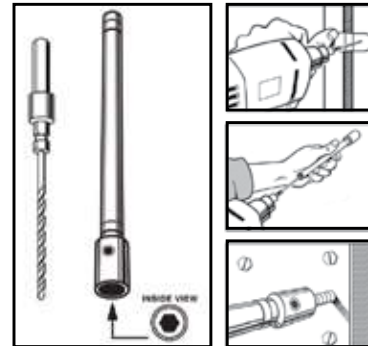

MIAMI-DADE COUNTY
APPROVED

NOA 19.0326.03



DROP IN ANCHOR



DROP IN ANCHOR - CARBON STEEL (INCLUDES FREE SETTING TOOL IN BOX)

Part #	Size
268010	1/4"
268020	3/8"
268030	1/2"
268040	5/8"
268050	3/4"

DROP IN ANCHOR - 304 STAINLESS (INCLUDES FREE SETTING TOOL IN BOX)

Part #	Size
619010	1/4"
619020	3/8"
619030	1/2"
619040	5/8"
619050	3/4"



SHORTY DROP IN (INCLUDES FREE SETTING TOOL IN BOX)

Part #	Size
268220	3/8"



ICC-ES Evaluation Report

ESR-3981

Reissued October 2018

This report is subject to renewal October 2020.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 03 00 00—CONCRETE
Section: 03 16 00—Concrete Anchors

DIVISION: 05 00 00—METALS
Section: 05 05 19—Post-Installed Concrete Anchors

REPORT HOLDER:

BRIGHTON BEST INTERNATIONAL, INC.

EVALUATION SUBJECT:

**US ANCHOR ULTRAWEDGE+ WEDGE ANCHORS IN
 CRACKED AND UNCRACKED CONCRETE**

1.0 EVALUATION SCOPE

Compliance with the following codes:

- 2015, 2012, 2009 and 2006 *International Building Code*® (IBC)
- 2015, 2012, 2009 and 2006 *International Residential Code*® (IRC)

For evaluation for compliance with codes adopted by the Los Angeles Department of Building and Safety (LADBS), see [ESR-3981 LABC and LARC Supplement](#)

Property evaluated:

Structural

2.0 USES

US Anchor Ultrawedge+ Wedge Anchors are used as anchorage in cracked and uncracked normalweight concrete and lightweight concrete having a specified compressive strength, f'_c , of 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa) to resist static, wind, seismic tension and shear loads.

The US Anchor Ultrawedge+ Wedge Anchors comply with anchors as described in Section 1901.3 of 2015 IBC, Section 1909 of the 2012 IBC, and Section 1912 of the 2009 and 2006 IBC. The anchors are alternatives to cast-in-place anchors described in Section 1908 of the 2012 IBC and Section 1911 of the 2009 and 2006 IBC. The anchors may also be used under the IRC where an engineered design is submitted in accordance with Section R301.1.3.

3.0 DESCRIPTION

3.1 US Anchor Ultrawedge+ Wedge Anchors:

The US Anchor Ultrawedge+ Wedge Anchors are torque-controlled, mechanical expansion anchors. The anchors consist of a stud (anchor body), nut, washer, and expander wedge (clip) as illustrated in Figure 1 of this report. The stud

for all sizes is manufactured from cold-drawn carbon steel meeting the requirements of UNS G10350 and is partially threaded with one end terminating in a flared mandrel. The expander wedge (clip) is manufactured from Chinese steel standard GB/T3522 Grade 50 steel subsequently through hardened to Rockwell HRC 28-32 and is formed around the stud mandrel so it is able to move freely. The clip movement is restrained by the mandrel taper and by a collar. The anchor is installed in a predrilled hole with a hammer. When torque is applied to the nut of the installed anchor, the mandrel is drawn into the expansion element, which is in turn expanded against the wall of the drilled hole. All components, including nuts and washers, are zinc-coated in accordance with ASTM B633 classification SC1, Type III. Installation information and dimensions are set forth in Section 4.3 and Table 1 and Table 2 of this report.

3.2 Concrete:

Normalweight and lightweight concrete must comply with Sections 1903 and 1905 of the IBC, as applicable.

4.0 DESIGN AND INSTALLATION

4.1 Strength Design:

4.1.1 General: Design strength of anchors complying with the 2015 IBC, as well as Section R301.1.3 of the 2015 IRC must be determined in accordance with ACI 318-14 Chapter 17 and this report.

Design strength of anchors complying with the 2012 IBC, as well as Section R301.1.3 of the 2012 IRC, must be determined in accordance with ACI 318-11 Appendix D and this report.

Design strength of anchors complying with the 2009 IBC, as well as Section R301.1.3 of the 2009 IRC, must be determined in accordance with ACI 318-08 Appendix D and this report.

Design strength of anchors complying with the 2006 IBC and Section R301.1.3 of the 2006 IRC must be determined in accordance with ACI 318-05 Appendix D and this report.

The strength design of anchors must comply with ACI 318-14 17.3.1 or ACI 318 (-11, -08, -05) D.4.1, as applicable. Strength reduction factors, ϕ , as given in ACI 318-14 17.3.3 or ACI 318-11 D.4.3 or ACI 318 (-08, -05) D.4.4, as applicable, and noted in Table 1 of this report, must be used for load combinations calculated in accordance with Section 1605.2 of the IBC, Section 5.3 of ACI 318-14 and Section 9.2 of ACI 318 (-11, -08, -05), as applicable. Strength reduction factors, ϕ , given in ACI 318-11 D.4.4 or ACI 318 (-08, -05) D.4.5 must be used for load combinations calculated in accordance with ACI 318 (-11, -08, -05), Appendix C. The value of f'_c , used

in calculations must be limited to a maximum of 8,000 psi (55.2 MPa), in accordance with ACI 318-14 17.2.7 or ACI 318-11 D.3.7, as applicable.

4.1.2 Requirements for Static Steel Strength in Tension, N_{sa} : The nominal steel strength of a single anchor in tension, N_{sa} , calculated in accordance with ACI 318-14 17.4.1.2 or ACI 318 (-11, -08, -05) D.5.1.2, as applicable, must be calculated based on the information given in Table 1 and must be used for design. The strength reduction factor, ϕ , corresponding to a ductile steel element may be used.

4.1.3 Requirements for Static Concrete Breakout Strength in Tension, N_{cb} or N_{cbg} : The nominal concrete breakout strength of a single anchor or a group of anchors in tension (N_{cb} and N_{cbg} , respectively), must be calculated in accordance with ACI 318-14 17.4.2 or ACI 318 (-11, -08, -05) D.5.2, as applicable, with modifications as described in this section. The basic concrete breakout strength in tension, N_b , must be calculated in accordance with ACI 318-14 17.4.2.2 or ACI 318 (-11, -08, -05) D.5.2.2, as applicable, using the values of h_{ef} , k_{cr} and k_{uncr} as given in Table 1 of this report. The nominal concrete breakout strength in tension in regions of concrete where analysis indicates no cracking at service loads must be calculated in accordance with ACI 318-14 17.4.2.6 or ACI 318 (-11, -08, -05) D.5.2.6, as applicable, with $\psi_{c,N} = 1.0$ and k_{uncr} as given in Table 1. The value of f'_c used in the calculations must be limited to 8,000 psi (55.2 MPa), in accordance with ACI 318-14 17.2.7 or ACI 318-11 D.3.7, as applicable.

4.1.4 Requirements for Pullout Strength in Tension, N_{pn} : The nominal pullout strength of a single anchor in tension in accordance with ACI 318-14 17.4.3 or ACI 318 (-11, -08, -05) D.5.3, as applicable, in cracked and uncracked concrete, $N_{p,cr}$ and $N_{p,uncr}$, respectively, is given in Table 1. In lieu of ACI 318-14 17.4.3.6 or ACI 318 (-11, -08, -05) D.5.3.6, as applicable, $\psi_{c,P} = 1.0$ for all design cases. In accordance with ACI 318-14 17.4.3 or ACI 318 (-11, -08, -05) D.5.3, as applicable the nominal pullout strength in cracked concrete may be calculated in accordance with the following equation:

$$N_{p,f'_c} = N_{p,cr} \sqrt{\frac{f'_c}{2,500}} \quad (\text{lb, psi}) \quad (\text{Eq-1})$$

$$N_{p,f'_c} = N_{p,cr} \sqrt{\frac{f'_c}{17.2}} \quad (\text{N, MPa})$$

In regions where analysis indicates no cracking in accordance with ACI 318-14 17.4.3.6 or ACI 318 (-11, -08, -05) D.5.3.6 as applicable, the nominal pullout strength in tension may be calculated in accordance with the following equation:

$$N_{p,f'_c} = N_{p,uncr} \sqrt{\frac{f'_c}{2,500}} \quad (\text{lb, psi}) \quad (\text{Eq-2})$$

$$N_{p,f'_c} = N_{p,uncr} \sqrt{\frac{f'_c}{17.2}} \quad (\text{N, MPa})$$

Where values for $N_{p,cr}$ or $N_{p,uncr}$ are not provided in Table 1 of this report, the pullout strength in tension need not be evaluated.

4.1.5 Requirements for Static Steel Strength in shear, V_{sa} : The nominal steel strength in shear, V_{sa} , of a single anchor in accordance with ACI 318-14 17.5.1.2 or ACI 318 (-11, -08, -05) D.6.1.2, as applicable, is given in Table 1 of this report and must be used in lieu of the values derived by

calculation from ACI 318-14 Eq. 17.5.1.2b or ACI 318 (-11, -08, -05) Eq. D-29, as applicable. The strength reduction factor, ϕ , corresponding to a ductile steel element may be used.

4.1.6 Requirements for Static Concrete Breakout Strength in Shear, V_{cb} or V_{cbg} : The nominal concrete breakout strength of a single anchor or group of anchors in shear (V_{cb} or V_{cbg} , respectively), must be calculated in accordance with ACI 318-14 17.5.2 or ACI 318 (-11, -08, -05) D.6.2, as applicable, with modifications as described in this section. The basic concrete breakout strength in shear, V_b , must be calculated in accordance with ACI 318-14 17.5.2.2 or ACI 318 (-11, -08, -05) D.6.2.2, as applicable, based on the values provided in Table 1 of this report and using the value of l_e according to Table 1 of this report.

4.1.7 Requirements for Static Concrete Pryout Strength of Anchor in Shear, V_{cp} or V_{cpg} : The nominal concrete pryout strength of a single anchor or group of anchors (V_{cp} or V_{cpg} , respectively), must be calculated in accordance with ACI 318-14 17.5.3 or ACI 318 (-11, -08, -05) D.6.3, as applicable, modified by using the value of k_{cp} provided in Table 1 and the value of N_{cb} or N_{cbg} as calculated in Section 4.1.3 of this report.

4.1.8 Requirements for Seismic Design:

4.1.8.1 General: For load combinations including seismic, the design must be performed in accordance with ACI 318-14 17.2.3 or ACI 318 (-11, -08, -05) D.3.3, as applicable. Modifications to ACI 318-14 17.2.3 shall be applied under Section 1905.1.8 of the 2015 IBC. For the 2012 IBC, Section 1905.1.9 shall be omitted. Modifications to ACI 318 (-08, -05) D.3.3 shall be applied under Section 1908.1.9 of the 2009 IBC, or Section 1908.1.16 of the 2006 IBC, as applicable.

The anchors must comply with ACI 318-14 2.3 or ACI 318-11 D.1, as applicable, as ductile steel elements and must be designed in accordance with ACI 318-14 17.2.3.4, 17.2.3.5, 17.2.3.6 or 17.2.3.7; or ACI 318-11 D.3.3.4, D.3.3.5, D.3.3.6 or D.3.3.7; ACI 318-08 D.3.3.4, D.3.3.5 or D.3.3.6; or ACI 318-05 D.3.3.4 or D.3.3.5, as applicable. Strength reduction factors, ϕ , are given in Table 1 of this report. The anchors may be installed in Seismic Design Categories A through F of the IBC.

4.1.8.2 Seismic Tension: The nominal steel strength and nominal concrete breakout strength for anchors in tension must be calculated in accordance with ACI 318-14 17.4.1 and 17.4.2 or ACI 318-11 D.5.1 and D.5.2, as applicable, as described in Sections 4.1.2 and 4.1.3 of this report. In accordance with ACI 318-14 17.4.3.2 or ACI 318-11 D.5.3.2, as applicable, the appropriate pullout strength in tension for seismic loads, $N_{p,eq}$, described in Table 1 must be used in lieu of N_p , as applicable. The value of $N_{p,eq}$ may be adjusted by calculation for concrete strength in accordance with Eq-1 and Section 4.1.4 of this report. If no values for $N_{p,eq}$ are given in Table 1, the static design strength values govern.

4.1.8.3 Seismic Shear: The nominal concrete breakout strength and pryout strength in shear must be calculated in accordance with ACI 318-14 17.5.2 and 17.5.3 or ACI 318-11 D.6.2 and D.6.3, respectively, as applicable, as described in Sections 4.1.6 and 4.1.7 of this report. In accordance with ACI 318-14 17.5.1.2 or ACI 318-11 D.6.1.2, as applicable, the appropriate value for nominal steel strength for seismic loads, $V_{sa,eq}$ described in Table 1 must be used in lieu of V_{sa} , as applicable.

4.1.9 Requirements for Interaction of Tensile and Shear Forces: For anchors or groups of anchors that are

subjected to the effects of combined tensile and shear forces, the design must be determined in accordance with ACI 318-14 17.6 or ACI 318 (-11, -08, -05) D.7, as applicable.

4.1.10 Requirements for Critical Edge Distance: In applications where the installed edge distance $c < c_{ac}$ and supplemental reinforcement to control splitting of the concrete is not present, the concrete breakout strength for the anchors loaded in tension for uncracked concrete, calculated in accordance with ACI 318-14 17.4.2 or ACI 318 (-11, -08, -05) D.5.2, as applicable, must be further multiplied by the factor $\psi_{cp,N}$ as given by Eq-3:

$$\psi_{cp,N} = \frac{c}{c_{ac}} \quad (\text{Eq-3}) \text{ where}$$

the factor $\psi_{cp,N}$ need not be taken as less than $\frac{1.5h_{ef}}{c_{ac}}$.

For all other cases, $\psi_{cp,N} = 1.0$. In lieu of using ACI 318-14 17.7.6 or ACI 318 (-11, -08, -05) D.8.6, as applicable, values of c_{ac} must be taken from Table 1. In all cases, c must not be less than c_{min} described in Table 1 of this report.

4.1.11 Requirements for Minimum Member Thickness, Minimum Anchor Spacing and Minimum Edge Distance: In lieu of using ACI 318-14 17.7.1 and 17.7.3 or ACI 318 (-11, -08, -05) D.8.1 and D.8.3, as applicable, values of s_{min} and c_{min} as given in Table 1 of this report must be used. In lieu of using ACI 318-14 17.7.5 or ACI 318 (-11 -08, -05) D.8.5, as applicable, minimum member thicknesses h_{min} as given in Table 1 of this report must be used.

4.1.12 Lightweight Concrete: For the use of anchors in lightweight concrete, the modification factor λ_a equal to 0.8 λ is applied to all values of $\sqrt{f'_c}$ affecting N_n and V_n .

For ACI 318-14 (2015 IBC), ACI 318-11 (2012 IBC) and ACI 318-08 (2009 IBC), λ shall be determined in accordance with the corresponding version of ACI 318.

For ACI 318-05 (2006 IBC), λ shall be taken as 0.75 for all lightweight concrete and 0.85 for sand-lightweight concrete. Linear interpolation shall be permitted if partial sand replacement is used. In addition, the pullout strengths $N_{p,uncr}$, $N_{p,cr}$ and $N_{p,eq}$ shall be multiplied by the modification factor, λ_a , as applicable.

4.2 Allowable Stress Design (ASD):

4.2.1 General: Design values for use with allowable stress design (working stress design) load combinations, calculated in accordance with Section 1605.3 of the IBC, must be established in accordance with the following equations:

$$T_{allowable,ASD} = \frac{\phi N_n}{\alpha}$$

$$V_{allowable,ASD} = \frac{\phi V_n}{\alpha}$$

where:

$T_{allowable,ASD}$ = Allowable tension load (lbf or kN)

$V_{allowable,ASD}$ = Allowable shear load (lbf or kN)

ϕN_n = Lowest design strength of an anchor or anchor group in tension as determined in accordance with ACI 318-14 Chapter 17 and 2015 IBC Section 1905.1.8, ACI 318-11 Appendix D, ACI 318-08 Appendix

D and 2009 IBC Section 1908.1.9, ACI 318-05 Appendix D and 2006 IBC Section 1908.1.16, and Section 4.1 of this report as applicable. (lbf or kN).

ϕV_n

= Lowest design strength of an anchor or anchor group in shear as determined in accordance with ACI 318-14 Chapter 17 and 2015 IBC Section 1905.1.8, ACI 318-11 Appendix D, ACI 318-08 Appendix D and 2009 IBC Section 1908.1.9, ACI 318-05 Appendix D and 2006 IBC Section 1908.1.16, and Section 4.1 of this report as applicable. (lbf or kN).

α

= Conversion factor calculated as a weighted average of the load factors for the controlling load combination. In addition, α must include all applicable factors to account for nonductile failure modes and required over-strength.

The requirements for member thickness, edge distance and spacing, described in this report, must apply. An example of allowable stress design values for illustrative purposes is provided in Table 3 of this report.

4.2.2 Interaction of Tensile and Shear Forces: The interaction must be calculated and consistent with ACI 318-14 17.6 or ACI 318 (-11, -08, -05) D.7, as applicable, as follows:

For shear loads $V_{applied} \leq 0.2V_{allowable,ASD}$, the full allowable load in tension must be permitted.

For tension loads $T_{applied} \leq 0.2T_{allowable,ASD}$, the full allowable load in shear must be permitted.

For all other cases:

$$\frac{T_{applied}}{T_{allowable,ASD}} + \frac{V_{applied}}{V_{allowable,ASD}} \leq 1.2 \quad (\text{Eq-4})$$

4.3 Installation:

Installation parameters such as embedment, spacing, edge distance, and concrete requirements, are provided in Table 1 and Figure 2.

Anchor locations must comply with this report, and plans and specifications approved by the code official. US Anchor Ultrawedge+ Wedge Anchors must be installed in accordance with the manufacturer's published installation instructions and this report (see installation instructions at the end of this report). In case of conflict, this report governs.

4.4 Special Inspection:

Periodic special inspection is required in accordance with Section 1705.1.1 and Table 1705.3 of the 2015 IBC and 2012 IBC, Section 1704.15 and Table 1704.4 of the 2009 IBC, or Section 1704.13 of the 2006 IBC, as applicable. The special inspector must make periodic inspections during anchor installation to verify anchor type, anchor dimensions, concrete type, concrete compressive strength, drill bit type, hole dimensions, hole cleaning procedure, concrete member thickness, anchor embedment, anchor spacing, edge distances, tightening torque and adherence to the manufacturer's printed installation instructions. The special inspector must be present as often as required in accordance with the "statement of special inspection." Under the IBC, additional requirements as set forth in Sections 1705, 1706 and 1707 must be observed, when applicable.

5.0 CONDITIONS OF USE

The US Anchor Ultrawedge+ Wedge Anchors described in this report comply with, or are suitable alternatives to what is specified in, those codes listed in Section 1.0 of this report, subject to the following conditions:

- 5.1 The anchors must be installed in accordance with the manufacturer's published installation instructions and this report. In case of a conflict, this report governs.
- 5.2 The anchors must be limited to use in cracked and uncracked normal-weight concrete and lightweight concrete having a specified compressive strength, f'_c , of 2,500 psi to 8,500 psi (17.2 MPa to 58.6 MPa).
- 5.3 Anchor sizes, dimensions, minimum embedment depths, and other installation parameters are as set forth in this report.
- 5.4 The values of f'_c used for calculation purposes must not exceed 8,000 psi (55.1 MPa).
- 5.5 The concrete shall have attained its minimum design strength prior to the installation of the anchors.
- 5.6 Strength design values must be established in accordance with Section 4.1 of this report.
- 5.7 Allowable stress design values must be established in accordance with Section 4.2.
- 5.8 Anchor spacing(s) and edge distance(s) as well as minimum member thickness must comply with Table 1.
- 5.9 Prior to installation, calculations and details demonstrating compliance with this report must be submitted to the code official. The calculations and details must be prepared by a registered design professional where required by the statutes of the jurisdiction in which the project is to be constructed.
- 5.10 Since an ICC-ES acceptance criteria for evaluating data to determine the performance of anchors subjected to fatigue or shock loading is unavailable at this time, the use of these anchors under such conditions is beyond the scope of this report.
- 5.11 Anchors may be installed in regions of concrete where cracking has occurred or where analysis indicates cracking may occur ($f_t > f_r$), subject to the conditions of this report.
- 5.12 The anchors may be used to resist short-term loading due to wind or seismic forces in locations designated as Seismic Design Categories A through F of the IBC, subject to the conditions of this report.

5.13 Where not otherwise prohibited in the code, US Anchor Ultrawedge+ Wedge Anchors are permitted for use with fire-resistance-rated construction provided that at least one of the following conditions is fulfilled:

- The anchors are used to resist wind forces only.
- Anchors that support a fire-resistance-rated envelope or a fire-resistance-rated membrane are protected by approved fire-resistance-rated materials, or have been evaluated for resistance to fire exposure in accordance with recognized standards.
- Anchors are used to support nonstructural elements.

5.14 Use of the anchors is limited to dry, interior locations.

5.15 Special inspection must be provided as set forth in Section 4.4 of this report.

5.16 Anchors are manufactured for Brighton Best International, Inc. under an approved quality-control program with inspections by ICC-ES.

6.0 EVIDENCE SUBMITTED

Data in accordance with the ICC-ES Acceptance Criteria for Mechanical Anchors in Concrete Elements (AC193), dated October 2015; which incorporates requirements in ACI 355.2-07, for use in cracked and uncracked concrete; including tests 18 and 19 of Table 4.2 of Annex A of AC193 for seismic tension and shear, and quality control documentation.

7.0 IDENTIFICATION

7.1 The anchors are identified by packaging labeled with the company name (Brighton Best), product name, anchor diameter and length, part number, production lot number and the evaluation report number (ESR-3981).

7.2 The report holder's contact information is the following:

BRIGHTON BEST INTERNATIONAL, INC.
12801 LEFFINGWELL AVENUE
SANTE FE SPRINGS, CALIFORNIA 90670
(562) 483-2740
www.brightonbest.com

CHARACTERISTIC	SYMBOL	UNITS	Nominal Anchor Diameter			
			³ / ₈ inch	¹ / ₂ inch	⁵ / ₈ inch	³ / ₄ inch
Installation Information						
Anchor diameter	<i>d_a</i> (<i>d_o</i>) ³	in.	³ / ₈	¹ / ₂	⁵ / ₈	³ / ₄
Minimum diameter of hole clearance in fixture	<i>d_h</i>	in.	⁷ / ₁₆	⁹ / ₁₆	¹¹ / ₁₆	¹³ / ₁₆
Nominal drill bit diameter	<i>d_{bit}</i>	in.	³ / ₈	¹ / ₂	⁵ / ₈	³ / ₄
Minimum nominal embedment depth	<i>h_{nom}</i>	in.	2 ³ / ₈	2 ¹ / ₂	3 ⁹ / ₁₆	4 ¹ / ₈
Minimum effective embedment depth	<i>h_{ef}</i>	in.	2	2	3	3 ¹ / ₂
Minimum hole depth	<i>h_o</i>	in.	2 ³ / ₄	2 ³ / ₄	3 ³ / ₄	4 ¹ / ₂
Installation torque	<i>T_{inst}</i>	ft-lb	35	50	90	125
Minimum edge distance	<i>c_{min}</i>	in.	4	7	6	7
Minimum spacing	<i>s_{min}</i>	in.	6	12	8	9
Minimum concrete thickness	<i>h_{min}</i>	in.	4 ¹ / ₂	6 ¹ / ₂		
Critical edge distance	<i>c_{ac}</i>	in.	8	10	13	11
Anchor Design Data						
Category number	1, 2 or 3	–	1	1	1	1
Yield strength of anchor steel	<i>f_{ya}</i>	lb/in ²	87,200	84,000	81,600	81,600
Ultimate strength of anchor steel	<i>f_{uta}</i>	lb/in ²	109,000	105,000	102,000	102,000
Tension						
Effective tensile stress area (neck)	<i>A_{se,N}</i>	in ²	0.056	0.103	0.164	0.238
Steel strength in tension	<i>N_{sa}</i>	lb.	6,104	10,815	16,728	24,276
Reduction factor for steel failure modes ⁵	<i>ϕ</i>	-	0.75			
Effectiveness factor for concrete breakout, cracked	<i>k_{cr}</i>	-	17	21	21	24
Effectiveness factor for concrete breakout, uncracked	<i>k_{uncr}</i>	-	24	24	27	27
Reduction factor for concrete breakout ⁶	<i>ϕ</i>	-	0.65 (Condition B)			
Pull-out resistance, cracked concrete ⁴	<i>N_{p,cr}</i>	lb.	N/A	N/A	4,037	N/A
Pull-out resistance, uncracked concrete ⁴	<i>N_{p,uncr}</i>	lb.	3,013	N/A	N/A	N/A
Pull-out resistance, seismic loads ⁴	<i>N_{p,eq}</i>	lb.	N/A	N/A	4,037	N/A
Reduction factor for pull-out ⁶	<i>ϕ</i>	-	0.65 (Condition B)			
Axial stiffness in service load range (cracked)	<i>β_{cr}</i>	lb/in	37,300	44,600	40,300	55,800
Axial stiffness in service load range (uncracked)	<i>β_{uncr}</i>	lb/in	277,400	230,400	105,700	401,200
Shear						
Effective shear stress area (threads)	<i>A_{se,V}</i>	in ²	0.078	0.142	0.226	0.334
Load-bearing length of anchor	<i>ℓ_e</i>	in.	2	2	3	3 ¹ / ₂
Reduction factor for concrete breakout or pryout ⁶	<i>ϕ</i>	-	0.70 (Condition B)			
Coefficient for pryout strength	<i>k_{cp}</i>	-	1.0		2.0	
Steel strength in shear, non-seismic ⁷	<i>V_{sa}</i>	lb.	2,508	5,500	9,923	18,317
Steel strength in shear, seismic	<i>V_{sa,eq}</i>	lb.	2,006	4,400	7,938	16,485
Reduction factor for steel failure ⁵	<i>ϕ</i>	-	0.65			

For **SI**: 1 in = 25.4 mm, 1 in² = 6.451×10⁻⁴ m, 1 ft-lb = 1.356 Nm, 1 lb/in² = 6.895 Pa.

¹The information presented in this table must be used in conjunction with the design criteria of ACI 318-14 Chapter 17 or ACI 318 Appendix D, as applicable.

²Installation must comply with the manufacturer's published installation instructions.

³The notation in parentheses is for the 2006 IBC.

⁴See Section 4.1.4 of this report. N/A (not applicable) denotes that this value does not control for design.

⁵Anchors are considered to be manufactured using ductile steel in accordance with ACI 318-14 2.3 or ACI 318 (-11, -08, -05) D.1. Strength reduction factors are for use with the load combinations of ACI 318-14 Section 5.3, ACI 318 (-11, -08, -05) Section 9.2 or IBC Section 1605.2, as applicable.

⁶Condition B applies where supplementary reinforcement in conformance with ACI 318-14 17.3.3(c) or ACI 318-11 D.4.3(c) or ACI 318 (-08, -05) D.4.4(c) is not provided, or where pull-out or pry-out strength governs. For cases where supplementary reinforcement can be verified, the strength reduction factors associated with Condition A may be used. Strength reduction factors are for use with the load combinations of ACI 318-14 Section 5.3, ACI 318 (-11, -08, -05) Section 9.2 or IBC Section 1605.2.

⁷Tabulated values must be used for design, since these values are lower than those calculated with ACI 318-14 Eq. (17.5.1.2b), ACI 318-11 Eq. (D-29), or ACI 318-08 and ACI 318-05 Eq. (D-20), as applicable.

TABLE 2—US ANCHOR ULTRAWEDGE+ WEDGE ANCHOR LENGTH CODE IDENTIFICATION SYSTEM

Length ID marking on threaded stud head		A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
Overall anchor length, l_{anch} , (inches)	From	1½	2	2½	3	3½	4	4½	5	5½	6	6½	7	7½	8	8½	9	9½	10	11
	Up to but not including	2	2½	3	3½	4	4½	5	5½	6	6½	7	7½	8	8½	9	9½	10	11	12

For SI: 1 inch = 25.4 mm.

INSTALLATION INSTRUCTIONS

1. Use a rotary hammer drill in the percussion mode with the correct size carbide drill bit meeting the requirements of ANSI Standard B212-15 to drill the hole perpendicular to the concrete surface and to the required depth.
2. Use a hand pump, compressed air or vacuum to remove debris and dust from the drilling operation.
3. If installation is through a fixture, position the fixture over the hole and install the anchor through the hole in the fixture. Using a hammer, drive the anchor into the hole, insuring that it is installed to the minimum required embedment depth, h_{nom} .
4. Install the washer and nut on the projecting thread, and tighten the nut to the required installation torque value, T_{inst} , using a torque wrench.

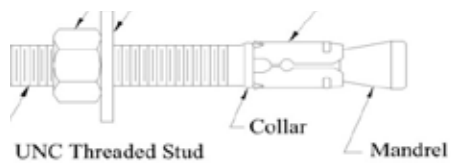


FIGURE 1—US ANCHOR ULTRAWEDGE+ WEDGE ANCHOR COMPONENTS

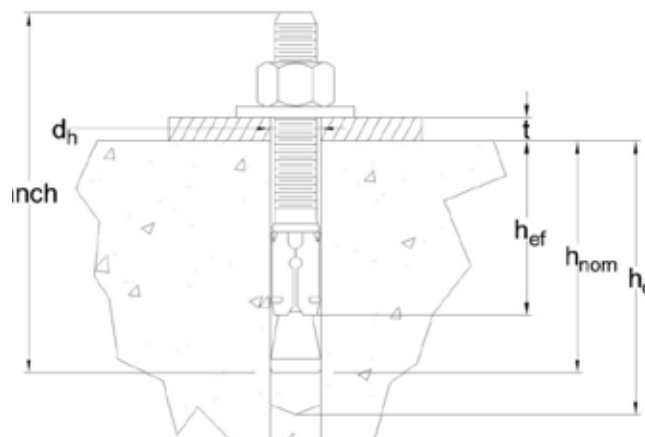


FIGURE 2—US ANCHOR ULTRAWEDGE+ WEDGE ANCHOR INSTALLATION

TABLE 3—EXAMPLE OF ALLOWABLE STRESS DESIGN VALUES FOR ILLUSTRATIVE PURPOSES ^{1, 2, 3, 4, 5, 6, 7, 8}

Nominal Anchor Diameter, d_a (d_o) (in.)	Nominal Embedment Depth, h_{nom} (in.)	Effective Embedment Depth, h_{ef} (in.)	Allowable Tension Load, uncracked (lbs.)
$\frac{3}{8}$	$2\frac{3}{8}$	2	1323
$\frac{1}{2}$	$2\frac{1}{2}$	2	1491
$\frac{5}{8}$	$3\frac{9}{16}$	3	3081
$\frac{3}{4}$	$4\frac{1}{8}$	$3\frac{1}{2}$	3882

¹Single anchor with static tension only

²Concrete determined to remain uncracked for the life of the anchorage

³Load combinations from ACI 318-14 Section 5.3 or ACI 318 (-11, -08, -05) Section. 9.2, as applicable and strength reduction factors from ACI 318 Condition B (supplementary reinforcement not provided)

⁴Controlling load combination 30% dead and 70% live loads, $1.2D+1.6L$

⁵Calculation of weighted average $\alpha = 1.2(0.3) + 1.6(0.7) = 1.48$

⁶Normalweight concrete with $f'_c = 2,500$ psi

⁷ $C_{a1} = C_{a2} \geq C_{ac}$

⁸ $h \geq h_{min}$

ICC-ES Evaluation Report

ESR-3981 LABC and LARC Supplement

Reissued October 2018

This report is subject to renewal October 2020.

www.icc-es.org | (800) 423-6587 | (562) 699-0543 A Subsidiary of the International Code Council®

DIVISION: 03 00 00—CONCRETE

Section: 03 16 00—Concrete Anchors

DIVISION: 05 00 00—METALS

Section: 05 05 19—Post-Installed Concrete Anchors

REPORT HOLDER:

BRIGHTON BEST INTERNATIONAL, INC.

EVALUATION SUBJECT:

US ANCHOR ULTRAWEDGE+ WEDGE ANCHORS IN CRACKED AND UNCRACKED CONCRETE

1.0 REPORT PURPOSE AND SCOPE

Purpose:

The purpose of this evaluation report supplement is to indicate that US Anchor Ultrawedge+ Wedge Anchors in cracked and uncracked concrete, described in ICC-ES master evaluation report [ESR-3981](#), have also been evaluated for compliance with the codes noted below as adopted by the Los Angeles Department of Building and Safety (LADBS).

Applicable code editions:

- 2017 *City of Los Angeles Building Code* (LABC)
- 2017 *City of Los Angeles Residential Code* (LARC)

2.0 CONCLUSIONS

The US Anchor Ultrawedge+ Wedge Anchors in cracked and uncracked concrete, described in Sections 2.0 through 7.0 of the master evaluation report [ESR-3981](#), comply with the LABC Chapter 19, and the LARC, and are subject to the conditions of use described in this supplement.

3.0 CONDITIONS OF USE

The US Anchor Ultrawedge+ Wedge Anchors in cracked and uncracked concrete described in this evaluation report must comply with all of the following conditions:

- All applicable sections in the master evaluation report [ESR-3981](#).
- The design, installation, conditions of use and identification of the anchors are in accordance with the 2015 *International Building Code*® (2015 IBC) provisions noted in the master evaluation report [ESR-3981](#).
- The design, installation and inspection are in accordance with additional requirements of LABC Chapters 16 and 17, as applicable.
- Under the LARC, an engineered design in accordance with LARC Section R301.1.3 must be submitted.
- The allowable and strength design values listed in the master evaluation report and tables are for the connection of the anchors to the concrete. The connection between the anchors and the connected members shall be checked for capacity (which may govern).

This supplement expires concurrently with the master report, reissued October 2018.

ICC-ES Evaluation Report

ESR-3981 FBC Supplement

Reissued October 2018

This report is subject to renewal October 2020.

www.icc-es.org | (800) 423-6587 | (562) 699-0543

A Subsidiary of the International Code Council®

DIVISION: 03 00 00—CONCRETE
Section: 03 16 00—Concrete Anchors

DIVISION: 05 00 00—METALS
Section: 05 05 19—Post-Installed Concrete Anchors

REPORT HOLDER:

BRIGHTON BEST INTERNATIONAL, INC.

EVALUATION SUBJECT:

US ANCHOR ULTRAWEDGE+ WEDGE ANCHORS IN CRACKED AND UNCRACKED CONCRETE

1.0 REPORT PURPOSE AND SCOPE

Purpose:

The purpose of this evaluation report supplement is to indicate that the Brighton Best International, Inc. US Anchor Ultrawedge+ Wedge Anchors in cracked and uncracked concrete, recognized in ICC-ES master evaluation report ESR-3981, have also been evaluated for compliance with the codes noted below.

Applicable code editions:

- 2014 *Florida Building Code—Building*
- 2014 *Florida Building Code—Residential*

2.0 CONCLUSIONS

The Brighton Best International, Inc. US Anchor Ultrawedge+ Wedge Anchors in cracked and uncracked concrete, described in master evaluation report ESR-3981, comply with the *Florida Building Code—Building* and the *Florida Building Code—Residential*, when designed and installed in accordance with the 2012 *International Building Code*® provisions noted in the master report, and under the following conditions:

- Design wind loads must be based on Section 1609 of the *Florida Building Code—Building* or Section 301.2.1.1 of the *Florida Building Code—Residential*, as applicable.
- Load combinations must be in accordance with Section 1605.2 or Section 1605.3 of the *Florida Building Code—Building*, as applicable.

Use of the Brighton Best International, Inc. US Anchor Ultrawedge+ Wedge Anchors in cracked and uncracked concrete has also been found to be in compliance with the High-Velocity Hurricane Zone (HVHZ) provisions of the *Florida Building Code—Building* and *Florida Building Code—Residential*, provided that the design wind loads for use of the anchors in the HVHZ are based on Section 1620 of the *Florida Building Code—Building*.

For products falling under Florida Rule 9N-3, verification that the report holder's quality-assurance program is audited by a quality-assurance entity approved by the Florida Building Commission for the type of inspections being conducted is the responsibility of an approved validation entity (or the code official, when the report holder does not possess an approval by the Commission).

This supplement expires concurrently with the master report, reissued October 2018.



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION
NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

Brighton Best International, Inc.
12801 Leffingwell Avenue
Santa Fe Springs, CA 90670

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: US Anchor Ultrawedge & Ultrawedge+ Anchor

APPROVAL DOCUMENT: Drawing No. 1, titled "US Anchor Ultrawedge & Ultrawedge+ Anchor", sheets 1 through 5 of 5, prepared by manufacturer, dated on 05/03/2018, signed and sealed by Lee W. Mattis, P.E., bearing the Miami-Dade County Product Control revision stamp with the Notice of Acceptance number and expiration date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each box shall bear a permanent label with the manufacturer's name or logo, Ningbo City, Zhejiang Province, China and following statement: "Miami-Dade County Product Control Approved or MDCPCA", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA revises NOA # 14-0902.09 and consists of this page 1, evidence pages E-1 and E-2, as well as approval document mentioned above.

The submitted documentation was reviewed by **Carlos M. Utrera, P.E.**



[Signature]
06/16/2018

NOA No: 18-0403.04
Expiration Date: February 25, 2021
Approval Date: June 14, 2018
Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

1. EVIDENCE SUBMITTED UNDER PREVIOUS NOA'S

A. DRAWINGS *"Submitted under NOA # 14-0902.09"*

1. Drawing No. 1, titled "US Anchor Ultrawedge Anchor", sheets 1 through 3 of 3, dated 11/17/2015, prepared by manufacture, signed and sealed by Lee W. Mattis, P.E.

B. TESTS *"Submitted under NOA # 14-0902.09"*

1. Test report on Tension and Shear Strength Design Values of 1/2", 5/8" and 3/4" diameters US Anchor Ultrawedge Anchors per AC193, ACI 355.2 and ASTM E 488, prepared by CEL Consulting, Inc., Test Report No. **15B269**, dated 03/06/2015, revised on 04/03/2015, signed and sealed by Lee W. Mattis, P.E.
2. Test report on Tension and Shear Strength Design Values of 3/8" diameter US Anchor Ultrawedge Anchors per AC193, ACI 355.2 and ASTM E 488, prepared by CEL Consulting, Inc., Test Report No. **14B256A**, dated 12/08/2014, revised on 12/15/2014 signed and sealed by Lee W. Mattis, P.E.
3. Test report on Corrosion Resistance of 5/8" Ultrawedge Anchors per ASTM G 85, Annex 5 and TAS 114, Appendix E, prepared by Element Materials Technology, Test Report No. **ESP020309P**, dated 07/31/2015, signed by Thomas A. Kolden, P.E.
4. Test report on Corrosion Resistance of 3/8", 1/2" and 3/4" Ultrawedge Anchors per ASTM G 85, Annex 5 and TAS 114, Appendix E, prepared by Element Materials Technology, Test Report No. **ESP019482P**, dated 04/21/2015, signed by Thomas A. Kolden, P.E.

C. CALCULATIONS

1. None.

D. MATERIAL CERTIFICATIONS


1. None.

E. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

F. STATEMENTS *"Submitted under NOA # 14-0902.09"*

1. Statement letter of code conformance to the 5th edition (2014) FBC and no financial interest issued by CEL Consulting, Inc., dated 11/17/2015, signed and sealed by Lee W. Mattis, P.E.
2. Articles of incorporation of Brighton Best International, Inc., dated 07/19/2010, signed by Glenn Kurosaki.
3. Distributor agreement dated 12/02/2015.



Carlos M. Utrera, P.E.

Product Control Examiner

NOA No: 18-0403.04

Expiration Date: February 25, 2021

Approval Date: June 14, 2018

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

2. NEW EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. 1, titled "US Anchor Ultrawedge & Ultrawedge+ Anchors", sheets 1 through 5 of 5, dated 05/03/2018, prepared by manufacturer, signed and sealed by Lee W. Mattis, P.E.

B. TESTS

1. Test report on Tension and Shear Strength Design Values of 3/8", 1/2", 5/8" and 3/4" diameters US Anchor Ultrawedge+ Wedge Anchors per AC193, ACI 355.2 and ASTM E 488, prepared by CEL Consulting, Inc., Test Report No. **17B353**, dated 06/16/2017, signed and sealed by Lee W. Mattis, P.E.
2. Test report on Tension and Shear Strength Design Values of 3/8", 1/2", 5/8" and 3/4" diameters US Anchor Ultrawedge+ Wedge Anchors per AC193, ACI 355.2 and ASTM E 488, prepared by CEL Consulting, Inc., Test Report No. **17B353 Supplement**, dated 09/01/2017, revised on 09/18/2017 signed and sealed by Lee W. Mattis, P.E.
3. Test report drawings of 3/8", 1/2", 5/8" and 3/4" diameters US Anchor Ultrawedge+ Wedge Anchors, prepared by CEL Consulting, Inc., Test Report No. **17B353 Supplement**, dated 09/29/2017, signed and sealed by Lee W. Mattis, P.E.

C. CALCULATIONS

1. None.

D. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

E. MATERIAL CERTIFICATIONS

1. None.

F. STATEMENTS



1. Statement letter of code conformance to the 6th edition (2017) FBC and of no financial interest, issued, dated 05/03/2018, signed and sealed by Lee W. Mattis, P.E.



Carlos M. Utrera, P.E.
Product Control Examiner
NOA No: 18-0403.04
Expiration Date: February 25, 2021
Approval Date: June 14, 2018


US Anchor Ultrawedge Anchor

Description: The Ultrawedge Wedge Anchor is a torque-controller wedge anchor consisting of a threaded steel stud with a cone mandrel at the embedded end. A clip expander is fitted on the mandrel. The anchor is installed by driving into a hole drilled with a carbide bit of the same nominal diameter as the anchor. The anchor is set by tightening the nut against an attached fixture, forcing the clip outward against the concrete hole wall with increasing pressure as the cone mandrel is drawn upwards. Resistance to withdrawal is developed by a combination of friction and local crushing of the concrete hole wall. The anchor bodies are manufactured from UNS G10350 steel. The clip for the 3/8" size is manufactured from UNS G001005 steel. The clips for the 1/2" 5/8" and 3/4" sizes are manufactured from UNS G001050 steel. All steels are Chinese-sourced meeting the AISI requirements. The anchor bodies and clips have an electroplated zinc coating in conformance to ASTM B633, SC1, Type III.

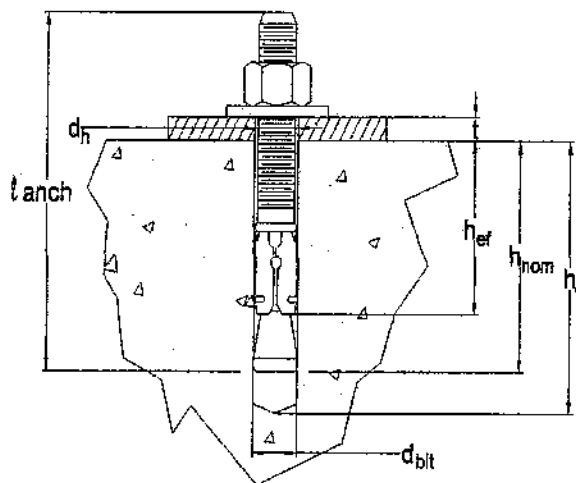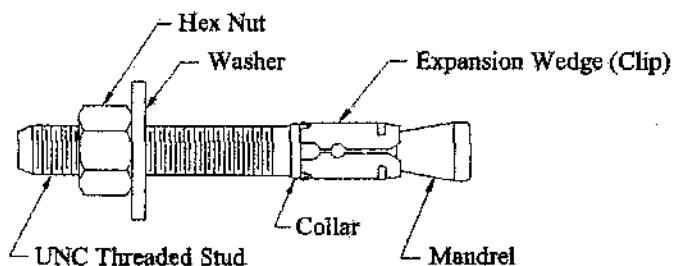

INSTALLATION INSTRUCTIONS

1. Drill the hole perpendicular to the surface with a carbide tipped bit that meets ANSI B212.15 specification using a rotary hammer drill with percussion. The drill bit size will be the same as the anchor diameter that is being installed.
2. Drill the hole a minimum of 1/2" deeper than the specified nominal embedment, h_{nom} .
3. Blow out the hole with compressed air or a blow-out bulb.
4. Assemble the nut and washer on the anchor and insert through the hole in the material to be fastened.
5. Drive the anchor into the drilled hole with a hammer to at least the required nominal embedment, h_{nom} .
6. Torque to the specified installation torque.

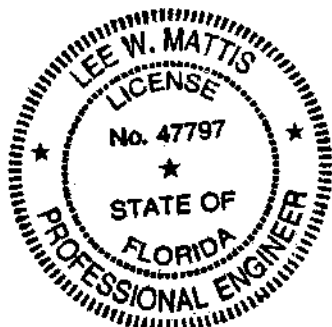

Lee W. Mattis
5/3/18

Part #	Size x Length (inches)	Part #	Size x Length (inches)
157060	3/8 x 2 1/4	157300	5/8 x 3 1/2
157070	3/8 x 2 3/4	157310	5/8 x 4 1/2
157080	3/8 x 3	157320	5/8 x 5
157090	3/8 x 3 3/4	157330	5/8 x 6
157100	3/8 x 5	157340	5/8 x 7
157180	1/2 x 2 3/4	157380	3/4 x 4 1/4
157190	1/2 x 3 3/4	157390	3/4 x 4 3/4
157200	1/2 x 4 1/4	157400	3/4 x 5 1/2
157210	1/2 x 4 1/2	157410	3/4 x 6 1/4
157220	1/2 x 5 1/2	157420	3/4 x 7
157230	1/2 x 7		

PRODUCT REVISED
as complying with the Florida
Building Code

NOA-No. **18-0403.04**

Expiration Date **02/25/2021**

By *[Signature]*
Miami-Dade Product Control


Title: US Anchor Ultrawedge Anchor
Drawing No: 1
5/3/18

By: LM

Brighton Best International, Inc.
12801 Leffingwell Avenue
Santa Fe Springs, California 90670

Sheet 1 of 5

TABLE 1—DATA FOR US ANCHOR ULTRAWEDGE ANCHORS FOR USE IN UNCRACKED CONCRETE^{1,2}

CHARACTERISTIC		SYMBOL	UNITS	Nominal Anchor Diameter			
				3/8 inch	1/2 inch	5/8 inch	3/4 inch
Installation Information							
Anchor diameter		d_a (d_a) ³	in.	3/8	1/2	5/8	3/4
Minimum diameter of hole clearance in fixture		d_h	in.	7/16	9/16	11/16	13/16
Nominal drill bit diameter		d_{bd}	in.	3/8	1/2	5/8	3/4
Minimum nominal embedment depth		h_{nom}	in.	2 3/8	2 1/2	3 9/16	4 1/8
Minimum effective embedment depth		h_{ef}	in.	2	2	3	3 1/2
Minimum hole depth	PRODUCT REVISED as complying with the Florida Building Code NOA-No. 18-0403.04 Expiration Date 02/25/2021 By  Miami-Dade Product Control	h_o	in.	2 3/4	3	4	4 1/2
Installation torque		T_{inst}	ft-lb	30	40	60	110
Minimum edge distance		c_{min}	in.	3	7	7	7
Minimum spacing		s_{min}	in.	4	7	7	7
Minimum concrete thickness		h_{mta}	in.	4	6	6	8
Critical edge distance		c_{ac}	in.	7	9	9	12
Anchor Design Data							
Category number		1, 2 or 3	—	1	1	1	1
Yield strength of anchor steel		f_{ya}	lb/in ²	105,000	92,200	91,200	93,400
Ultimate strength of anchor steel		f_{uta}	lb/in ²	119,200	103,700	102,650	105,000
Tension							
Effective tensile stress area (neck)		$A_{sa,N}$	in ²	0.056	0.110	0.173	0.262
Steel strength in tension		N_{ta}	lb.	6675	11,400	17,760	27,510
Reduction factor for steel failure modes ⁵		ϕ	—	0.75			
Effectiveness factor for concrete breakout		$k_{t,uncr}$	—	24	24	24	24
Reduction factor for concrete breakout ⁶		ϕ	—	0.65 (Condition B)			
Pull-out resistance ⁴		$N_{p,uncr}$	lb.	3125	3225	N/A ⁸	N/A ⁸
Reduction factor for pull-out ⁶		ϕ	—	0.65 (Condition B)			
Axial stiffness in service load range		β	lb/in	113,890	363,730	443,850	649,470
Shear							
Effective shear stress area (threads)		$A_{sa,V}$	in ²	0.078	0.142	0.226	0.334
Load-bearing length of anchor		l_e	in.	2	2	3	3 1/2
Reduction factor for concrete breakout or pryout ⁶		ϕ	—	0.70 (Condition B)			
Coefficient for pryout strength		k_{cp}	—	1.0		2.0	
Steel strength in shear ⁷		V_{sa}	lb.	3052	4954	9296	14,573
Reduction factor for steel failure ⁵		ϕ	—	0.65			

For SI: 1 in = 25.4 mm, 1 in² = 6.451 × 10⁻⁴ m², 1 ft-lb = 1.356 Nm, 1 lb/in² = 6.895 Pa.

¹ The information presented in this table must be used in conjunction with the design criteria of ACI 318-14 Chapter 17 or ACI 318 Appendix D as applicable.

² Installation must comply with the manufacturer's published installation instructions.

³ The notation in parentheses is for the 2006 IBC.


⁴ Adjust pullout resistance for concrete strengths greater than 2500 psi using the square root of the actual concrete strength divided by 2500.

⁵ Anchors are considered to be manufactured using ductile steel in accordance with applicable ACI 318 provisions. Strength reduction factors are for use with the load combinations of applicable ACI 318 provisions or IBC Section 1605.2.

⁶ Condition B applies where supplementary reinforcement in conformance with applicable ACI 318 provisions is not provided, or where pull-out or pry-out strength governs. For cases where supplementary reinforcement can be verified, the strength reduction factors associated with Condition A may be used. Strength reduction factors are for use with the load combinations of applicable ACI 318 provisions or IBC Section 1605.2.

⁷ Tabulated values must be used for design since these values are lower than those calculated with applicable ACI 318 provisions.

⁸ N/A denotes that pullout resistance is not applicable for these sizes and concrete breakout calculations per ACI 318 are applicable.

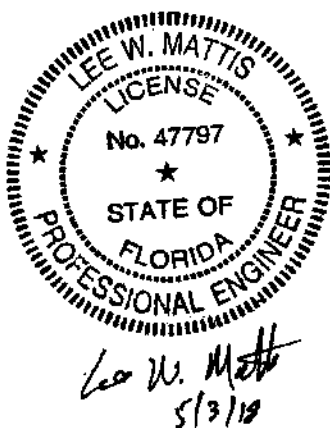



Title: US Anchor Ultrawedge Anchor
Drawing No: 1
5/3/18

By: LM

Brighton Best International, Inc.
12801 Leffingwell Avenue
Santa Fe Springs, California 90670
Sheet 2 of 5

US Anchor Ultrawedge+ Anchor


Description: The Ultrawedge+ Wedge Anchor is a torque-controller wedge anchor consisting of a threaded steel stud with a cone mandrel at the embedded end. A clip expander is fitted on the mandrel. The anchor is installed by driving into a hole drilled with a carbide bit of the same nominal diameter as the anchor. The anchor is set by tightening the nut against an attached fixture, forcing the clip outward against the concrete hole wall with increasing pressure as the cone mandrel is drawn upwards. Resistance to withdrawal is developed by a combination of friction and local crushing of the concrete hole wall. The anchor bodies are manufactured from UNS G10350 steel. The clips are manufactured from Chinese steel standard GB/T3522 Grade 50 (UNS G001050) steel. All steels are Chinese-sourced meeting the AISI requirements. The anchor bodies and clips have an electroplated zinc coating in conformance to ASTM B633, SC1, Type III.

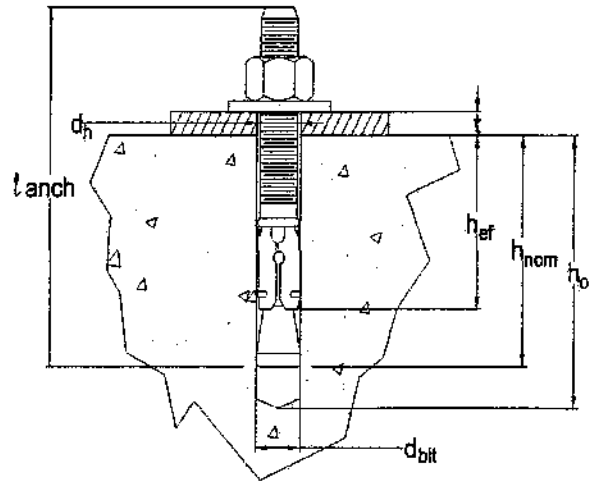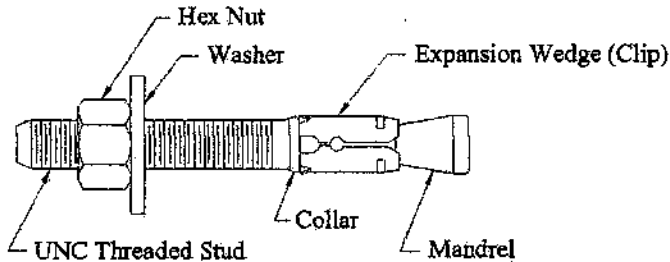

INSTALLATION INSTRUCTIONS

- 1 Drill the hole perpendicular to the surface with a carbide tipped bit that meets ANSI B212.15 specification using a rotary hammer drill with percussion. The drill bit size will be the same as the anchor diameter that is being installed.
- 2 Drill the hole deeper than the specified nominal embedment, h_{nom} as specified in Table 2 on Sheet 4.
- 3 Blow out the hole with compressed air or a blow-out bulb
- 4 Assemble the nut and washer on the anchor and insert through the hole in the material to be fastened
- 5 Drive the anchor into the drilled hole with a hammer to at least the required nominal embedment, h_{nom}
- 6 Torque to the specified installation torque

Part #	Size x Length (inches)	Part #	Size x Length (inches)
157060	3/8 x 2 1/4	157300	5/8 x 3 1/2
157070	3/8 x 2 3/4	157310	5/8 x 4 1/2
157080	3/8 x 3	157320	5/8 x 5
157090	3/8 x 3 3/4	157330	5/8 x 6
157100	3/8 x 5	157340	5/8 x 7
157180	1/2 x 2 3/4	157380	3/4 x 4 1/4
157190	1/2 x 3 3/4	157390	3/4 x 4 3/4
157200	1/2 x 4 1/4	157400	3/4 x 5 1/2
157210	1/2 x 4 1/2	157410	3/4 x 6 1/4
157220	1/2 x 5 1/2	157420	3/4 x 7
157230	1/2 x 7		

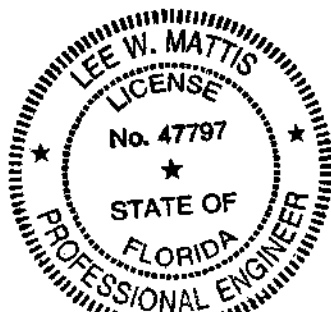


Lee W. Mattis
5/3/18

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **18-0403.04**
Expiration Date **02/25/2021**
By *[Signature]*
Miami-Dade Product Control

Title: US Anchor Ultrawedge+ Anchor Brighton Best International, Inc.
Drawing No: 1 12801 Leffingwell Avenue
5/3/18 By: LM Santa Fe Springs, California 90670
Sheet 3 of 5

TABLE 2—DATA FOR US ANCHOR ULTRAWEDGE+ ANCHORS FOR USE IN CRACKED & UNCRACKED CONCRETE ^{1,2}

Characteristic	Symbol	Units	Nominal Anchor Diameters			
			3/8	1/2	5/8	3/4
Installation Information						
Anchor diameter	PRODUCT REVISED $d_a(d_o)^3$	in.	3/8	1/2	5/8	3/4
Clearance hole dia.	as complying with the Florida Building Code d_h	in.	7/16	9/16	11/16	13/16
Nominal bit dia.	NOA-No. 18-0403.04 d_{bit}	in.	3/8	1/2	5/8	3/4
Nominal embedment ⁵	Expiration Date 02/25/2021 h_{nom}	in.	2 3/8	2 1/2	3 9/16	4 1/8
Effective embedment ⁹	By [Signature] h_{ef}	in.	2	2	3	3 1/2
Minimum hole depth	Miami Data Product Control h_o	in.	2 3/4	2 3/4	3 3/4	4 1/2
Installation torque	T_{inst}	ft-lbs	35	50	90	125
Minimum edge distance	c_{min}	in.	4	7	6	7
Minimum spacing	s_{min}	in.	6	12	8	9
Minimum concrete thickness	h_{min}	in.	4 1/2	6 1/2		
Critical edge distance	c_{cr}	in.	8	10	13	11
Anchor Design Data						
Category number	1,2, or 3	—	1	1	1	1
Yield strength of anchor steel	f_{yA}	psi	87,200	84,000	81,600	81,600
Ultimate strength of anchor steel	f_{uA}	psi	109,000	105,000	102,000	102,000
Tension						
Effective tensile stress area (neck)	$A_{se,N}$	in ²	0.056	0.103	0.164	0.238
Steel strength in tension	N_{ss}	lb.	6104	10,815	16,728	24,276
Reduction factor for steel failure modes ⁵	ϕ	-	0.75			
Effectiveness factor for concrete breakout, cracked	k_{cr}	-	17	21	21	24
Effectiveness factor for concrete breakout, uncracked	k_{uncr}	-	24	24	27	27
Reduction factor for concrete breakout ⁶	ϕ	-	0.65 (Condition B)			
Pull-out resistance, cracked concrete ⁴	$N_{p,cr}$	lb.	N/A	N/A	4037	N/A
Pull-out resistance, uncracked concrete ⁴	$N_{p,uncr}$	lb.	3013	N/A	N/A	N/A
Pull-out resistance, seismic loads ⁴	$N_{p,eq}$	lb.	N/A	N/A	4037	N/A
Reduction factor for pull-out ⁶	ϕ	-	0.65 (Condition B)			
Axial stiffness in service load range-cracked	β_{cr}	lb/in	37,300	44,600	40,300	55,800
Axial stiffness in service load range-uncracked	β_{uncr}	lb/in	277,400	230,400	105,700	401,200
Shear						
Effective shear stress area (threads)	$A_{se,V}$	in ²	0.078	0.142	0.226	0.334
Load-bearing length of anchor	l_e	in.	2	2	3	3 1/2
Reduction factor for concrete breakout or pryout	ϕ	-	0.70 (Condition B)			
Coefficient for pryout strength	k_{cp}	-	1.0		2.0	
Steel strength in shear, non-seismic ⁷	V_{sa}	lb.	2508	5500	9923	18,317
Steel strength in shear, seismic ⁷	$V_{sa,eq}$	lb.	2006	4400	7938	16,485
Reduction factor for steel failure ⁵	ϕ	-	0.65			

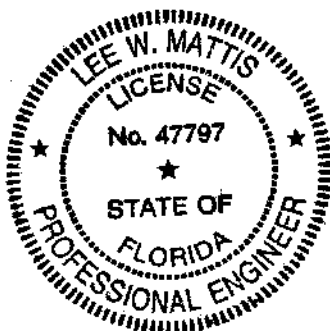For SI: 1 in = 25.4 mm, 1 in² = 6.451 × 10⁻⁴ m², 1 ft-lb = 1.356 Nm, 1 lb/in² = 6.895 Pa.

Lee W. Mattis
5/3/18

¹ The information presented in this table must be used in conjunction with the design criteria of ACI 318-14 Chapter 17 or ACI 318 Appendix D as applicable.² Installation must comply with the manufacturer's published installation instructions.³ The notation in parentheses is for the 2006 IBC.⁴ N/A denotes that pullout resistance is not applicable for these sizes and concrete breakout calculations per ACI 318 are applicable.⁵ Anchors are considered to be manufactured using ductile steel in accordance with applicable ACI 318 provisions. Strength reduction factors are for use with the load combinations of applicable ACI 318 or FBC provisions as applicable.⁶ Condition B applies where supplementary reinforcement in conformance with applicable ACI 318 provisions is not provided, or where pull-out or pry-out strength governs. For cases where supplementary reinforcement can be verified, the strength reduction factors associated with Condition A may be used. Strength reduction factors are for use with the load combinations of applicable ACI 318 or FBC provisions.⁷ Tabulated values must be used for design since these values are lower than those calculated with applicable ACI 318 or FBC provisions.⁸ Adjust pullout resistance for concrete strengths greater than 2500 psi using the square root of the actual concrete strength divided by 2500.⁹ Select overall anchor length to achieve minimum embedment which will depend on the thickness of the fixture being attached.

Title: US Anchor Ultrawedge+ Anchor Brighton Best International, Inc.

Drawing No: 1

5/3/18

By: LM

12801 Leffingwell Avenue


Santa Fe Springs, California 90670

Sheet 4 of 5

TABLE 3—US ANCHOR ULTRAWEDGE & ULTRAWEDGE+ ANCHOR LENGTH CODE IDENTIFICATION SYSTEM

Length ID marking on threaded stud head		A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S
Overall anchor length, L_{anch} , (inches)	From	1 1/2	2	2 1/2	3	3 1/2	4	4 1/2	5	5 1/2	6	6 1/2	7	7 1/2	8	8 1/2	9	9 1/2	10	11
	Up to but not including	2	2 1/2	3	3 1/2	4	4 1/2	5	5 1/2	6	6 1/2	7	7 1/2	8	8 1/2	9	9 1/2	10	11	12

For SI: 1 inch = 25.4 mm.

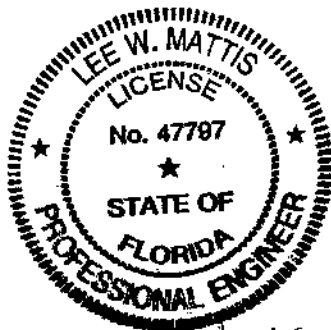

Lee W. Mattis
5/3/18

PRODUCT REVISED
as complying with the Florida
Building Code
NOA-No. **18-0403.04**
Expiration Date **02/25/2021**
By *[Signature]*
Miami-Dade Product Control

Title: US Anchor Ultrawedge & Ultrawedge+ Anchors
Drawing No: 1
5/3/18

By: LM

Brighton Best International, Inc.
12801 Leffingwell Avenue
Santa Fe Springs, California 90670
Sheet 5 of 5



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

NOTICE OF ACCEPTANCE (NOA)

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION

11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599

www.miamidade.gov/economy

Brighton Best International, Inc.
12801 Leffingwell Avenue
Santa Fe Springs, CA 90670

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER-Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (In Miami-Dade County) and/ or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code, including the High Velocity Hurricane Zone.

DESCRIPTION: Tapping SD Concrete and Masonry Screws

APPROVAL DOCUMENT: Drawing No. AD19-11, titled "Tapping SD Concrete/Masonry Screws", sheet 1 of 1, prepared by the manufacturer, dated on 04/06/2018, signed and sealed by Yiping Wang, P.E. on 06/05/2019, bearing the Miami-Dade County Product Control approval stamp with the Notice of Acceptance number and approval date by the Miami-Dade County Product Control Section.

MISSILE IMPACT RATING: None

LABELING: Each box shall bear a permanent label with the manufacturer's name or logo, Taikyu, Taiwan and following statement: "Miami-Dade County Product Control Approved or MDCPCA", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of this page 1, evidence page E-1, as well as approval document mentioned above.

The submitted documentation was reviewed by Carlos M. Utrera, P.E.



Handwritten signature and date:
06/21/2019

NOA No: 19-0326.03
Expiration Date: June 27, 2024
Approval Date: June 27, 2019

Page 1

NOTICE OF ACCEPTANCE: EVIDENCE SUBMITTED

A. DRAWINGS

1. Drawing No. **AD19-11**, titled "Tapping SD Concrete/Masonry Screws", sheet 1 of 1, prepared by the manufacturer, dated on 04/06/2018, signed and sealed by Yiping Wang, P.E. on 06/05/2019.

B. TESTS

	<u>Test Report No.</u>	<u>Standard</u>	<u>Date</u>	<u>Signature</u>
1.	HETI-18-A1079	ASTM E488-15	02/28/19	Rafael E. Droz-Seda, P.E.
2.	HETI-18-A1004	ASTM E488-15/ACI 355.2-07	04/12/19	Rafael E. Droz-Seda, P.E.
3.	HETI-18-A1091	ASTM E488-15	02/28/19	Rafael E. Droz-Seda, P.E.
4.	HETI-17-A1017	ASTM E488-15/ACI 355.2-07	04/12/19	Rafael E. Droz-Seda, P.E.
5.	HETI-18-C103	ASTM C39-18	02/28/19	Rafael E. Droz-Seda, P.E.
6.	HETI-18-C104	ASTM C39-18	02/28/19	Rafael E. Droz-Seda, P.E.
7.	HETI-18-S317	ASTM G85-11	02/28/19	Rafael E. Droz-Seda, P.E.
8.	HETI-18-S320	ASTM G85-11	02/28/19	Rafael E. Droz-Seda, P.E.
9.	HETI-19-M502	ASTM F606-16	04/05/19	Rafael E. Droz-Seda, P.E.
10.	HETI-19-M503	ASTM F606-16	02/28/19	Rafael E. Droz-Seda, P.E.

C. CALCULATIONS

1. Anchor capacity calculations prepared by MCY Engineering, Inc., dated 04/16/2019, signed and sealed by Yiping Wang, P.E.

D. MATERIAL CERTIFICATIONS

1. None.

E. QUALITY ASSURANCE

1. Miami-Dade Department of Regulatory and Economic Resources (RER)

F. STATEMENTS

1. Statement letter of code conformance to the 6th edition (2017) FBC issued by MCY Engineering, Inc., dated 04/16/2019, signed and sealed by Yiping Wang, P.E.
2. Statement letter of no financial interest issued by MCY Engineering, Inc., dated 04/16/2019, signed and sealed by Yiping Wang, P.E.
3. Distributor agreement dated 05/28/2019.


06/21/2019

Carlos M. Utrera, P.E.
Product Control Examiner
NOA No: 19-0326.03
Expiration Date: June 27, 2024
Approval Date: June 27, 2019

BRIGHTON BEST INTERNATIONAL TAPKING SD CONCRETE / MASONRY SCREWS

COMPLIANCE SUMMARY

CODE: 2017 FLORIDA BUILDING CODE COMPLIANT

NOTE: N/A COMPLIANT

MATERIALS: SAE 1018 OR SAE 1021 STEEL

BASE COAT: GALVANIZED EXCEEDS 66045GTM A553M)

TOP COAT: ORGANIC COATING

COLOR: BLUE, WHITE, BRONZE AND SILVER

1/4" TAPKING SD

SCREW ULTIMATE STRENGTH: $F_u = 167 \text{ ksi}$

SCREW YIELD STRENGTH: $F_y = 151 \text{ ksi}$

3/16" TAPKING SD

SCREW ULTIMATE STRENGTH: $F_u = 192 \text{ ksi}$

SCREW YIELD STRENGTH: $F_y = 179 \text{ ksi}$

GENERAL NOTES

1- ANCHORS SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATION.

2- ANCHOR EMBEDMENT AND EDGE DISTANCE EXCLUDES STUCCO, FOAM, BRICK, AND OTHER WALL FINISHES.

3- ALLOWABLE DESIGN LOAD CAPACITIES ARE BASED ON ULTIMATE LOAD DIVIDED BY SAFETY FACTOR AS FOLLOWS:

- CONCRETE: SAFETY FACTOR = 4

- MASONRY: SAFETY FACTOR = 5







4- SUBSTRATES SHALL CONFORM TO:

- CONCRETE: ACI 318

- MASONRY: ASTM C-90

5- ANCHORS SHALL NOT BE INSTALLED INTO CRACKED CONCRETE AS DEFINED IN ACI 355.2.

6- THIS PRODUCT EVALUATION DOCUMENT IS GENERIC AND DOES NOT PROVIDE INFORMATION FOR A SPECIFIC SITE. FOR SITE CONDITIONS DIFFERENT FROM THE CONDITIONS DETAILED HEREIN, A LICENSED PROFESSIONAL ENGINEER OR REGISTERED ARCHITECT SHALL PREPARE SITE-SPECIFIC DOCUMENTS FOR USE IN CONJUNCTION WITH THE APPROVAL AND APPLY FOR MIAMI-DADE COUNTY PRODUCT CONTROL ONE-TIME NOTICE OF ACCEPTANCE.

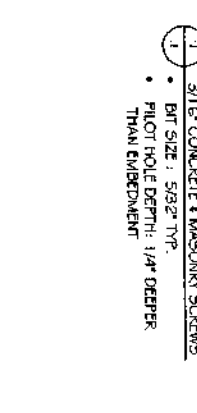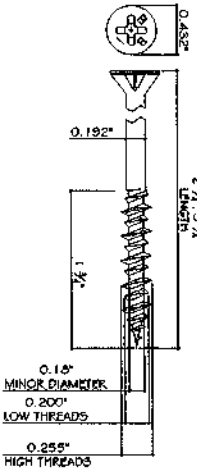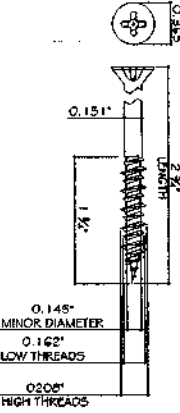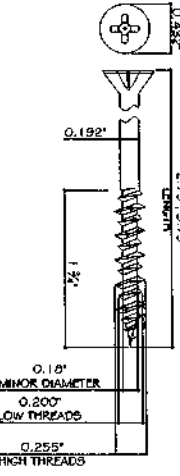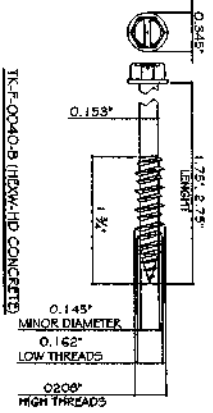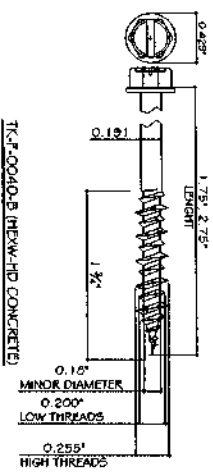

1/4" CONCRETE & MASONRY SCREWS
• BIT SIZE: 3/16" TYP.
• PILOT HOLE DEPTH: 1/4" DEEPER THAN EMBEDMENT

3/16" CONCRETE & MASONRY SCREWS
• BIT SIZE: 5/32" TYP.
• PILOT HOLE DEPTH: 1/4" DEEPER THAN EMBEDMENT

CONCRETE (FC = 2700 PSI) SUBSTRATE					
ALLOWABLE CAPACITIES PER ANCHOR					
ANCHOR DIAMETER	MINIMUM EMBEDMENT	MINIMUM EDGE DIST.	TENSION (LB)	SHEAR (LB)	
1/4"	1"	1-3/4"	252	252	
	2-1/4"	1-3/4"	263	263	
	3"	1"	231	231	
	4"	1"	93	154	
3/16"	1"	2-1/2"	90	226	
	1-3/8"	1"	149	134	
	2-1/2"	2"	146	246	
	3"	3"	303	175	
1/2"	1-1/2"	1-3/4"	431	405	
	2-1/2"	1"	305	130	
	3"	2-1/2"	429	418	
	4"	1"	137	99	
3/4"	1-3/8"	1"	168	259	
	2-1/2"	2"	277	136	
	3"	3"	375	364	
	4"	2-1/2"	444	369	
1"	1-3/4"	3"	421	-	
	2-1/2"	2"	324	260	
	3"	3"	375	364	
	4"	2-1/2"	444	369	

GROUT FILLED MASONRY SUBSTRATE					
ALLOWABLE CAPACITIES PER ANCHOR					
ANCHOR DIAMETER	MINIMUM EMBEDMENT	MINIMUM EDGE DIST.	TENSION (LB)	SHEAR (LB)	
1/4"	1-1/2"	1-3/4"	252	252	
	2-1/4"	1-3/4"	263	263	
	3"	1"	231	231	
	4"	1"	93	154	
3/16"	1"	2-1/2"	90	226	
	1-3/8"	1"	149	134	
	2-1/2"	2"	146	246	
	3"	3"	303	175	
1/2"	1-1/2"	1-3/4"	431	405	
	2-1/2"	1"	305	130	
	3"	2-1/2"	429	418	
	4"	1"	137	99	
3/4"	1-3/8"	1"	168	259	
	2-1/2"	2"	277	136	
	3"	3"	375	364	
	4"	2-1/2"	444	369	
1"	1-3/4"	3"	421	-	
	2-1/2"	2"	324	260	
	3"	3"	375	364	
	4"	2-1/2"	444	369	

HOLLOW MASONRY SUBSTRATE					
ALLOWABLE CAPACITIES PER ANCHOR					
ANCHOR DIAMETER	MINIMUM EMBEDMENT	MINIMUM EDGE DIST.	TENSION (LB)	SHEAR (LB)	
1/4"	1-1/2"	1-3/4"	252	252	
	2-1/4"	1-3/4"	263	263	
	3"	1"	231	231	
	4"	1"	93	154	
3/16"	1"	2-1/2"	90	226	
	1-3/8"	1"	149	134	
	2-1/2"	2"	146	246	
	3"	3"	303	175	
1/2"	1-1/2"	1-3/4"	431	405	
	2-1/2"	1"	305	130	
	3"	2-1/2"	429	418	
	4"	1"	137	99	
3/4"	1-3/8"	1"	168	259	
	2-1/2"	2"	277	136	
	3"	3"	375	364	
	4"	2-1/2"	444	369	
1"	1-3/4"	3"	421	-	
	2-1/2"	2"	324	260	
	3"	3"	375	364	
	4"	2-1/2"	444	369	

MIAMI-DADE COUNTY
PRODUCT APPROVED
as complying with the Florida
Building Code
NOA-No. 19-0326.03
Approval Date 06/27/2019
By *[Signature]*
Miami-Dade Product Control

APPROVED
FLORIDA REGISTERED
PROFESSIONAL ENGINEER
STATE OF FLORIDA
No. 19-0326.03
Date 06/27/2019

TAPKING SD CONCRETE / MASONRY SCREWS BRIGHTON BEST INTERNATIONAL 5855 OBISPO AVE. LONG BEACH CALIFORNIA 90805 TEL (306) 885-8282	MCY ENGINEERING, INC. GLAZING CONSULTANTS 8501 SW 124 Ave. Ste. 205A P. 305.271.0117 MIAMI, FL 33183 P. 786.380.2786 www.MCYEngineering.com mcy@mcyengineering.com
---	---

BRIGHTON BEST, INC.
ULTRAWEDGE+ ANCHOR - ENGINEERING DATA SHEET

Allowable Stress Values for Anchorages to Normal-Weight Concrete

ESR-3981 provides design information for load factor and resistance design (LRFD), however allowable stress design (ASD) is still in use by some users. Translation of LRFD to ASD values is possible, however it is dependent on the levels of dead load and live load. Dead load is defined in the ACI 318 Building Code Requirements for Structural Concrete as "the weights of members, supported structure and permanent attachments that are likely to be present on a structure in service". Live load is defined in ACI 318-14 as "load that is not permanently applied to a structure, but is likely to occur during the service life of the structure (excluding environmental loads)". Examples of live loads are traffic on a walkway and nonpermanent loads associated with usage of a structure. Live load values are stipulated in the building code for various loading conditions and parts of structures.

To facilitate the translation of LRFD design values to ASD design values, two scenarios of dead load and live load levels are used to conservatively address the most common applications as follows:

- 100% Dead Load

- 10% Dead Load and 90% Live Load

For 100% dead load, ACI 318-14 Table 5.3 Equation (5.3.1a) provides a conversion factor of 1.4 which is divided into the LRFD design loads and multiplied by a ϕ factor of 0.65 to determine an equivalent ASD load.

For 10% dead and 90% live load, ACI 318-14 Equation (5.3.1b) provides a conversion factor of 1.56 which is divided into the LRFD design loads and multiplied by a ϕ factor of 0.65 to determine an equivalent ASD load.

It is the responsibility of the user to select the appropriate ASD values based on the example loadings shown in this document or alternative dead versus live loading that may be applicable to the specific design.

The ASD values are provided in the following tables for tension and shear for each load scenario. Other installation and design provisions in ESR-3981 must be followed.

BRIGHTON BEST, INC.
ULTRAWEDGE+ ANCHOR - ENGINEERING DATA SHEET
 Allowable Stress Values for Attachments to Normal-Weight Concrete

ALLOWABLE TENSION LOADS FOR ULTRAWEDGE+ ANCHORS INSTALLED IN UNCRACKED NORMAL-WEIGHT CONCRETE – 100% DEAD LOAD (Pounds)^{1,2,3}

ANCHOR DIAMETER (inches)	MINIMUM NOMINAL EMBEDMENT (inches) ⁴	MINIMUM CONCRETE COMPRESSIVE STRENGTH, f_c' , psi				
		2500	3000	4000	5000	6000
3/8	2-3/8	1399	1532	1769	1978	2167
1/2	2-1/2	1576	1726	1993	2229	2441
5/8	3-9/16	3257	3568	4120	4606	5046
3/4	4-1/8	4104	4496	5191	5804	6358

ALLOWABLE NON-SEISMIC SHEAR LOADS FOR ULTRAWEDGE+ ANCHORS INSTALLED IN NORMAL-WEIGHT CONCRETE – 100% DEAD LOAD (Pounds)^{1,2,3}

ANCHOR DIAMETER (inches)	MINIMUM NOMINAL EMBEDMENT (inches) ⁴	MINIMUM CONCRETE COMPRESSIVE STRENGTH, f_c' , psi
		2500
3/8	2-3/8	1164
1/2	2-1/2	2554
5/8	3-9/16	4607
3/4	4-1/8	8504

ALLOWABLE TENSION LOADS FOR ULTRAWEDGE+ ANCHORS INSTALLED IN UNCRACKED NORMAL-WEIGHT CONCRETE – 10% DEAD LOAD, 90% LIVE LOAD (Pounds)^{1,2,3}

ANCHOR DIAMETER (inches)	MINIMUM NOMINAL EMBEDMENT (inches) ⁴	MINIMUM CONCRETE COMPRESSIVE STRENGTH, f_c' , psi				
		2500	3000	4000	5000	6000
3/8	2-3/8	1255	1375	1588	1775	1945
1/2	2-1/2	1414	1549	1789	2000	2191
5/8	3-9/16	2923	3202	3697	4134	4528
3/4	4-1/8	3683	4035	4659	5209	5706

ALLOWABLE NON-SEISMIC SHEAR LOADS FOR ULTRAWEDGE+ ANCHORS INSTALLED IN NORMAL-WEIGHT CONCRETE – 10% DEAD LOAD, 90% LIVE LOAD (Pounds)^{1,2,3}

ANCHOR DIAMETER (inches)	MINIMUM NOMINAL EMBEDMENT (inches) ⁴	MINIMUM CONCRETE COMPRESSIVE STRENGTH, f_c' , psi
		2500
3/8	2-3/8	1045
1/2	2-1/2	2292
5/8	3-9/16	4135
3/4	4-1/8	7632

Notes to all tables:

¹ Based on ESR-3981 LRFD values

² The tabulated values are for anchors installed in normal-weight concrete that has reached the minimum designated compressive strength at the time of installation.

³ Other installation and other design provisions in ESR-3981 must be followed

⁴ Measured from the concrete surface to the embedded end of the anchor (nominal embedment)

BRIGHTON BEST, INC.
ULTRAWEDGE+ ANCHOR - ENGINEERING DATA SHEET
 Allowable Stress Values for Attachments to Normal-Weight Concrete

ALLOWABLE TENSION LOADS FOR ULTRAWEDGE+ ANCHORS INSTALLED IN CRACKED NORMAL-WEIGHT CONCRETE – 100% DEAD LOAD (Pounds)^{1,2,3}

ANCHOR DIAMETER (inches)	MINIMUM NOMINAL EMBEDMENT (inches) ⁴	MINIMUM CONCRETE COMPRESSIVE STRENGTH, f_c' , psi				
		2500	3000	4000	5000	6000
3/8	2-3/8	1116	1223	1412	1579	1729
1/2	2-1/2	1379	1510	1744	1950	2136
5/8	3-9/16	1874	2053	2371	2651	2904
3/4	4-1/8	3648	3996	4615	5159	5652

ALLOWABLE SEISMIC SHEAR LOADS FOR ULTRAWEDGE+ ANCHORS INSTALLED IN NORMAL-WEIGHT CONCRETE – 100% DEAD LOAD (Pounds)^{1,2,3}

ANCHOR DIAMETER (inches)	MINIMUM NOMINAL EMBEDMENT (inches) ⁴	MINIMUM CONCRETE COMPRESSIVE STRENGTH, f_c' , psi
		2500
3/8	2-3/8	931
1/2	2-1/2	2043
5/8	3-9/16	3686
3/4	4-1/8	7654

ALLOWABLE TENSION LOADS FOR ULTRAWEDGE+ ANCHORS INSTALLED IN CRACKED NORMAL-WEIGHT CONCRETE – 10% DEAD LOAD, 90% LIVE LOAD (Pounds)^{1,2,3}

ANCHOR DIAMETER (inches)	MINIMUM NOMINAL EMBEDMENT (inches) ⁴	MINIMUM CONCRETE COMPRESSIVE STRENGTH, f_c' , psi				
		2500	3000	4000	5000	6000
3/8	2-3/8	1002	1097	1267	1417	1552
1/2	2-1/2	1237	1356	1565	1750	1917
5/8	3-9/16	1682	1843	2128	2379	2606
3/4	4-1/8	3274	3586	4141	4630	5072

ALLOWABLE SEISMIC SHEAR LOADS FOR ULTRAWEDGE+ ANCHORS INSTALLED IN NORMAL-WEIGHT CONCRETE – 10% DEAD LOAD, 90% LIVE LOAD (Pounds)^{1,2,3}

ANCHOR DIAMETER (inches)	MINIMUM NOMINAL EMBEDMENT (inches) ⁴	MINIMUM CONCRETE COMPRESSIVE STRENGTH, f_c' , psi
		2500
3/8	2-3/8	836
1/2	2-1/2	1833
5/8	3-9/16	3308
3/4	4-1/8	6869

Notes to all tables:

¹ Based on ESR-3981 LRFD values


² The tabulated values are for anchors installed in normal-weight concrete that has reached the minimum designated compressive strength at the time of installation.

³ Other installation and other design provisions in ESR-3981 must be followed

⁴ Measured from the concrete surface to the embedded end of the anchor (nominal embedment)

Proferred[®]

C A R B I D E

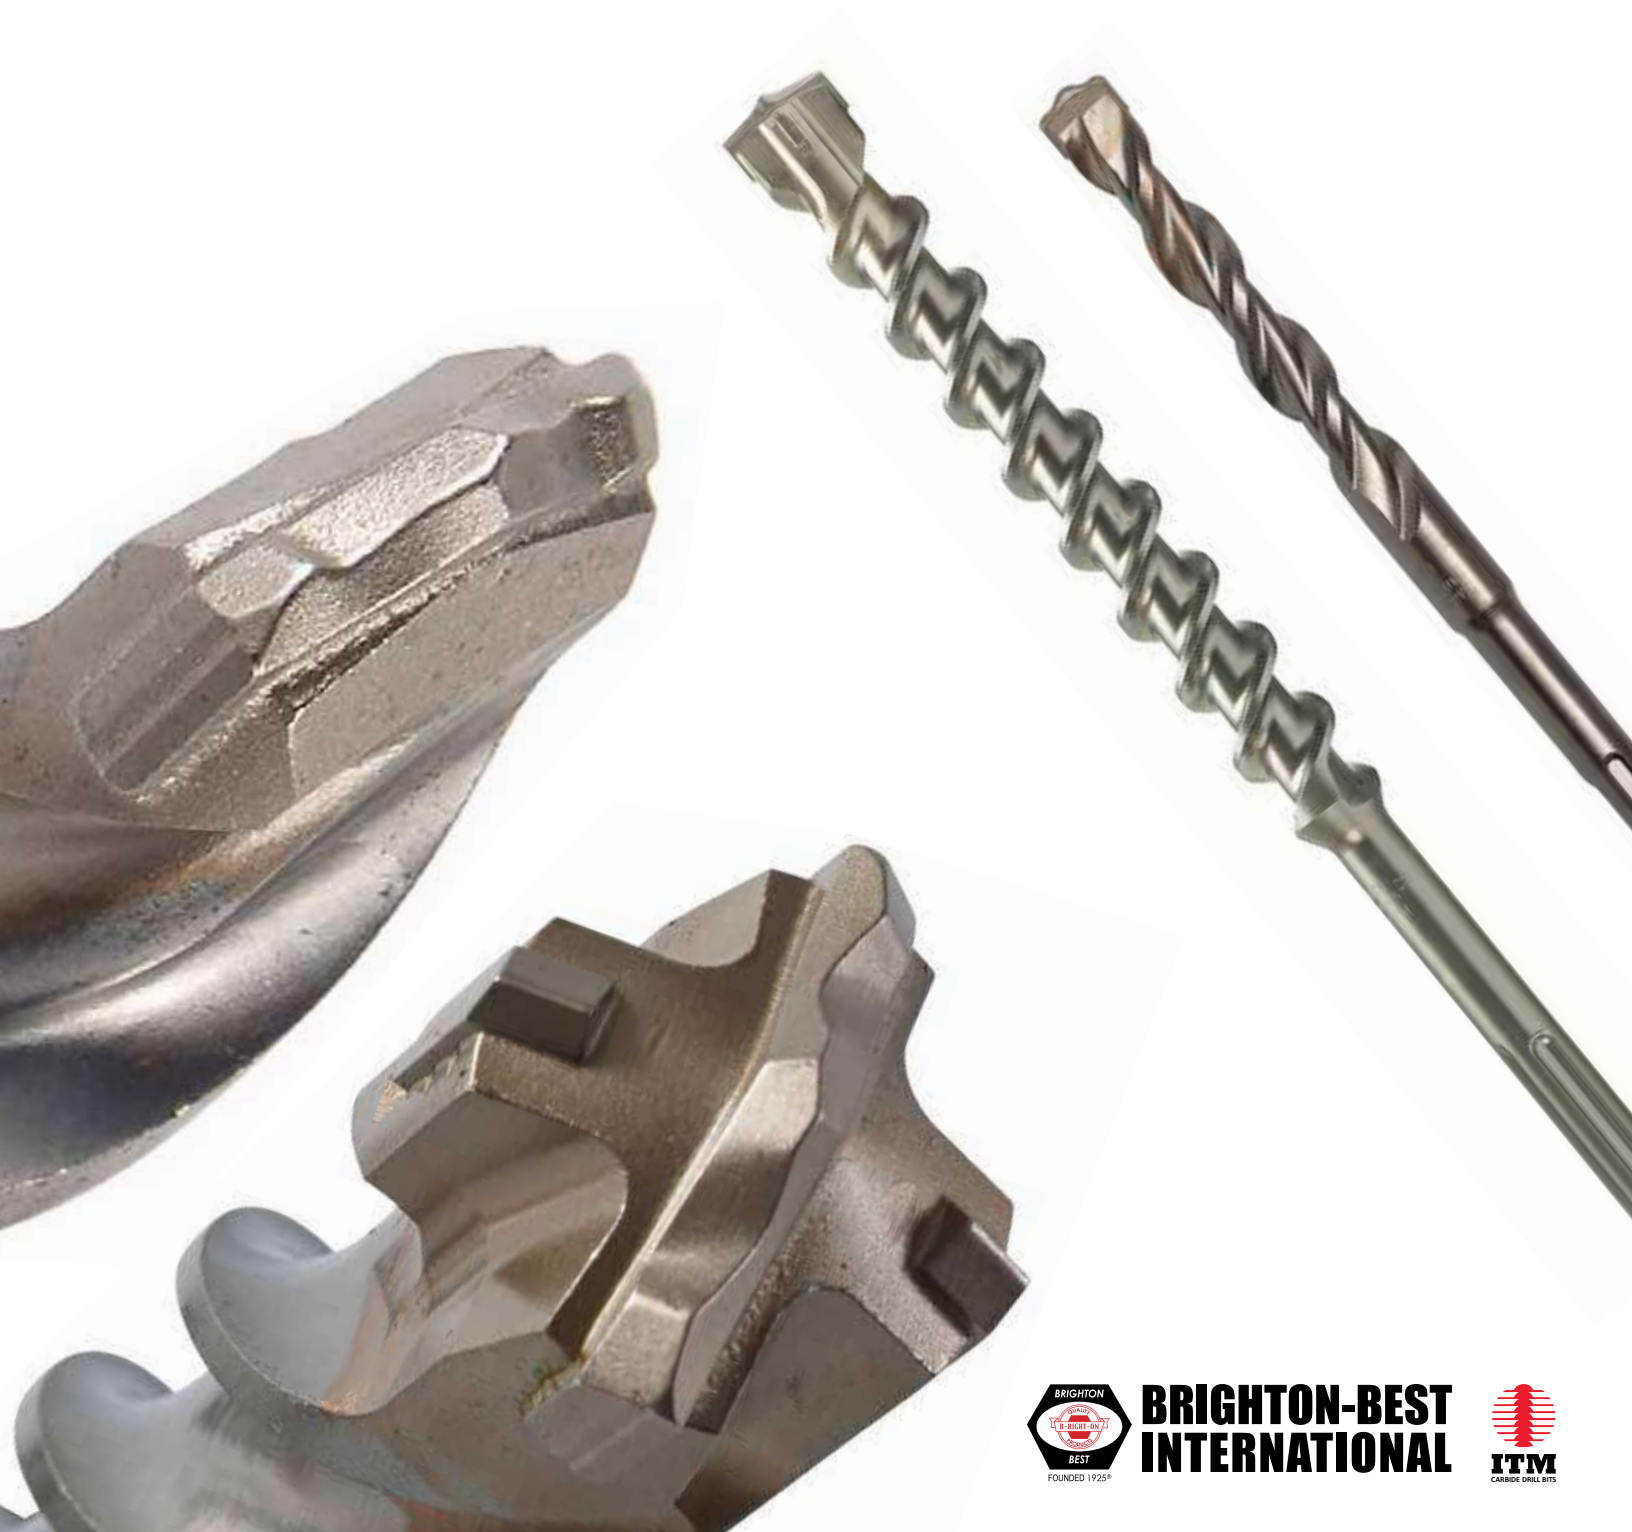

**BRIGHTON-BEST
INTERNATIONAL**





- ◆ Rotary Hammer Drill
- ◆ Serrated Head Geometry
- ◆ Self Centering Chisel Point
- ◆ ANSI Specification
- ◆ Tungsten Carbide Tip
- ◆ Copper / Silver Brazing
- ◆ Fastest Dust Removal
- ◆ Fastest Drilling Speeds
- ◆ Clean Round Holes
- ◆ Less Vibration
- ◆ Polished Finish
- ◆ Industrial Quality

→ **Concrete**
→ **Brick**
→ **Stone**
→ **Masonry**
→ **Aggregates**



**SOLD INDIVIDUALLY.
1 PER CLIP.**



SDS-PLUS Rotary Hammer Drills

Part #	Size	X	OAL	Drilling	Head	Qty.
C10009	5/32"	X	4-1/4"	2"	4-PLUS	1
C10010	5/32"	X	6-1/4"	4"	4-PLUS	1
C10020	3/16"	X	4-1/2"	2"	4-PLUS	1
C10030	3/16"	X	6-1/2"	4"	4-PLUS	1
C10031	3/16"	X	8-1/2"	6"	4-PLUS	1
C10032	3/16"	X	12-1/2"	10"	4-PLUS	1
C10033	7/32"	X	6-1/2"	4"	4-PLUS	1
C10034	7/32"	X	8-1/2"	6"	4-PLUS	1
C10035	7/32"	X	10-1/2"	8"	4-PLUS	1
C10036	7/32"	X	16"	14"	4-PLUS	1
C10040	1/4"	X	4-1/2"	2"	4-PLUS	1
C10050	1/4"	X	6-1/2"	4"	4-PLUS	1
C10051	1/4"	X	8-1/2"	6"	4-PLUS	1
C10052	1/4"	X	10-1/2"	8"	4-PLUS	1
C10053	1/4"	X	14"	12"	4-PLUS	1
C10054	1/4"	X	16"	14"	4-PLUS	1
C10060	5/16"	X	6-1/2"	4"	4-PLUS	1
C10070	5/16"	X	12-1/2"	10"	4-PLUS	1
C10080	3/8"	X	6-1/2"	4"	4-PLUS	1
C10090	3/8"	X	10-1/2"	8"	4-PLUS	1
C10100	3/8"	X	12-1/2"	10"	4-PLUS	1
C10101	3/8"	X	18"	16"	4-PLUS	1
C10102	3/8"	X	24"	22"	4-PLUS	1
C10110	7/16"	X	6-1/2"	4"	4-PLUS	1
C10111	7/16"	X	12-1/2"	10"	4-PLUS	1
C10120	1/2"	X	6-1/2"	4"	4-PLUS	1
C10130	1/2"	X	10-1/2"	8"	4-PLUS	1
C10140	1/2"	X	12-1/2"	10"	4-PLUS	1
C10141	1/2"	X	18"	16"	4-PLUS	1
C10142	1/2"	X	24"	22"	4-PLUS	1
C10150	9/16"	X	6-1/4"	4"	4-PLUS	1
C10160	9/16"	X	12-1/4"	10"	4-PLUS	1
C10170	5/8"	X	6-1/4"	4"	4-PLUS	1
C10171	5/8"	X	8-1/4"	6"	4-PLUS	1
C10190	5/8"	X	12-1/4"	10"	4-PLUS	1
C10191	5/8"	X	18"	16"	4-PLUS	1
C10192	5/8"	X	24"	22"	4-PLUS	1
C10193	3/4"	X	8"	6"	4-PLUS	1
C10220	3/4"	X	12"	10"	4-PLUS	1
C10221	3/4"	X	18"	16"	4-PLUS	1
C10222	3/4"	X	24"	22"	4-PLUS	1
C10223	7/8"	X	8"	6"	4-PLUS	1
C10230	7/8"	X	10"	8"	4-PLUS	1
C10231	7/8"	X	12"	10"	4-PLUS	1
C10240	1"	X	10"	8"	4-PLUS	1
C10241	1"	X	18"	16"	4-PLUS	1



SDS-MAX® Rotary Hammer Drills

Part #	Size	X	OAL	Drilling	Head	Qty.
C13100	3/8"	X	13"	7-1/2"	REGULAR	1
C13102	1/2"	X	13"	7-1/2"	REGULAR	1
C13104	1/2"	X	21"	15-1/2"	REGULAR	1
C13106	9/16"	X	21"	15-1/2"	REGULAR	1
C13108	5/8"	X	13"	7-1/2"	X-CUTTER	1
C13110	5/8"	X	21"	15-1/2"	X-CUTTER	1
C13112	5/8"	X	36"	30-1/2"	X-CUTTER	1
C13114	11/16"	X	21"	15-1/2"	X-CUTTER	1
C13116	3/4"	X	13"	8"	X-CUTTER	1
C13118	3/4"	X	21"	17"	X-CUTTER	1
C13120	3/4"	X	36"	31"	X-CUTTER	1
C13122	7/8"	X	13"	8"	X-CUTTER	1
C13124	7/8"	X	21"	17"	X-CUTTER	1
C13126	7/8"	X	36"	31"	X-CUTTER	1
C13128	1"	X	13"	8"	X-CUTTER	1
C13130	1"	X	21"	17"	X-CUTTER	1
C13132	1"	X	36"	31"	X-CUTTER	1
C13134	1-1/8"	X	17"	12"	X-CUTTER	1
C13136	1-1/8"	X	21"	17"	X-CUTTER	1
C13138	1-1/8"	X	36"	31"	X-CUTTER	1
C13140	1-1/4"	X	15"	10"	X-CUTTER	1
C13142	1-1/4"	X	23"	18"	X-CUTTER	1
C13144	1-3/8"	X	23"	18"	X-CUTTER	1
C13146	1-1/2"	X	23"	18"	X-CUTTER	1
C13148	1-3/4"	X	23"	18"	X-CUTTER	1
C13150	2"	X	23"	18"	X-CUTTER	1



- ◆ Rotary Hammer Drill
- ◆ Industrial Quality
- ◆ Tungsten Carbide Tip
- ◆ Copper / Silver Brazing
- ◆ Fastest Dust Removal
- ◆ Fastest Drilling Speeds
- ◆ Heat Treated Body
- ◆ Clean Round Holes
- ◆ Less Vibration
- ◆ Polished Finish
- ◆ ANSI Specification

- ➔ Reinforced Concrete
- ➔ Brick
- ➔ Stone
- ➔ Masonry
- ➔ Aggregates



**SOLD INDIVIDUALLY.
1 PER TUBE.**

Bosch® License

WILL PENETRATE THROUGH REINFORCED CONCRETE



Proferred® CARBIDE



- ◆ Rotary Hammer Drill
- ◆ STOP - Lip Prevents Over-Drilling
- ◆ Drill Exact Depth For Drop-In Anchor
- ◆ Less Likely to Hit Rebar
- ◆ ANSI Specification

→ Concrete
→ Brick
→ Stone
→ Masonry
→ Aggregates



For Drop-in Anchors



GERMANY



ANSI



SDS-PLUS + STOP Rotary Hammer Bit

Part #	Size	Drill Depth	Anchor Size	Qty.
C12100	3/8"	1-1/16"	1/4"	1
C12102	1/2"	13/16"	3/8" Short	1
C12104	1/2"	1-11/16"	3/8"	1
C12106	5/8"	1-3/16"	1/2" Short	1
C12108	5/8"	2-1/16"	1/2"	1

Half Flat Shank



Concrete Bits - FOR CONCRETE-SCREWS

Part #	Size	x	OAL	Screw	Qty.
R62004	5/32"	X	3-1/2"	12	25
R62005	5/32"	X	4-1/2"	12	25
R62006	5/32"	X	5-1/2"	12	25
R62008	3/16"	X	3-1/2"	14	25
R62003	3/16"	X	4-1/2"	14	25
R62001	3/16"	X	5-1/2"	14	25
R62002	3/16"	X	6-3/4"	14	25
R62009	3/16"	X	7-5/8"	14	25

- ◆ Industrial Quality
- ◆ Tungsten Carbide Tip
- ◆ Used for 5/32" Screws and 3/16" Screws

FOR USE WITH CONCRETE-SCREW SLEEVE



Each concrete-screw carbide drill bit is precisely ground to match a certain tolerance to assure proper hole diameter and to achieve maximum thread holding power. The flat on the shank fits all drill adapters. The drill bit is specially heat treated to make it very durable.



SDS-HEX Bits - FOR CONCRETE-SCREWS

Part #	Size	x	OAL	Drilling	Qty.
C19200	5/32"	X	5"	2-1/2"	1
C19201	5/32"	X	7"	4-1/2"	1
C19100	3/16"	X	5"	2-1/2"	1
C19101	3/16"	X	7"	4-1/2"	1



GERMANY

- ◆ Industrial Quality
- ◆ Special Tungsten Carbide Tip
- ◆ Copper / Silver Brazing
- ◆ Polished Finish
- ◆ Used for 5/32" Screws and 3/16" Screws

FOR USE WITH CONCRETE-SCREW SLEEVE



SDS-HEX Rotary Hammer drill bits are specifically designed for concrete-screw installation. These SDS bits have a special 5/16" HEX shoulder for direct use with concrete screw installation sleeves, eliminating the need for drill adapters. The benefit of using an SDS-Plus machine instead of a standard rotation drill is 2-3X faster performance, especially in harder concretes. **SEE BELOW FOR INSTALLATION KIT**



Installation Kit

Part #	Description
--------	-------------

C99010 Installation Kit


INCLUDES:

- 5/32" x 7" SDS-PLUS Hex Bit
- 3/16" x 7" SDS-PLUS Hex Bit
- 1/4" Magnetic Driver
- 5/16" Magnetic Driver
- Phillips Bit Adapter
- Masonry Drill Adapter
- 6-1/2" Sleeve
- 1/8" Hex Key
- Phillips #2 x 1" Insert
- Phillips #3 x 1" Insert



- ◆ Red Case
- ◆ Black Hardware

This Installation Kit is Suitable for both Standard Concrete Bits & SDS-HEX Rotary Hammer Bits.

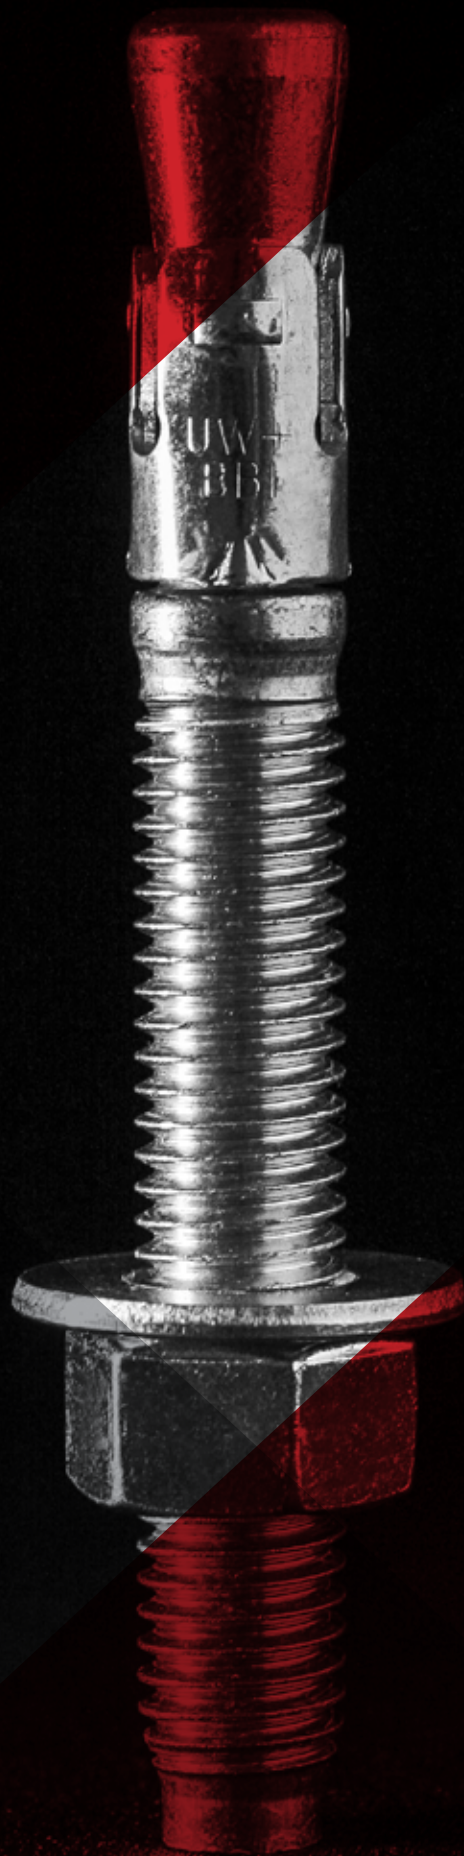



BRIGHTON-BEST INTERNATIONAL

www.brightonBEST.com • 1-800-275-0050

Global Headquarters

Tainan, Taiwan
No.122, Yi-Lin Road,
Rende Township,
Tainan, 71752 Taiwan
Tel. 886-6-270-1756

USA Headquarters

Long Beach, California
5855 Obispo Ave.
Long Beach, CA 90805
Tel. 562-808-8000
Fax: 562-808-8137

U.S.A.

Atlanta, GA
250 Horizon Dr.
Suwanee, GA 30024
Tel. 678-459-3700
Fax: 678-459-3720
WATS: 800-275-0056
atlanta@brightonbest.com

Boston, MA
928 West Chestnut St.
Brockton MA 02301
Tel. 508-857-2808
Fax: 774-296-8685
WATS: 800-275-0037
boston@brightonbest.com

Charlotte, NC
1810 West Pointe Dr., Unit A
Charlotte, NC 28214
Tel. 704-393-6711
Fax: 704-393-6715
WATS: 800-275-0050
charlotte@brightonbest.com

Chicago, IL
940 North Enterprise St.
Aurora, IL 60504
Tel. 630-898-9600
Fax: 630-898-9601
WATS: 800-929-2378
chicago@brightonbest.com

Cleveland, OH
21855 Commerce Pkwy.
Strongsville, OH 44149
Tel. 440-238-1350
Fax: 440-238-2336
WATS: 800-275-0048
cleveland@brightonbest.com

Dallas, TX
3225 Roy Orr Blvd., Ste. 200
Grand Prairie, TX 75050
Tel. 972-790-1201
Fax: 972-790-6265
WATS: 800-275-0054
dallas@brightonbest.com

Denver, CO
9700 E. 56th Ave., Unit 120
Denver, CO 80238
Tel. 303-576-0530
Fax: 303-371-9775
WATS: 800-935-2202
denver@brightonbest.com

Detroit, MI
6060 Stoney View Dr., Ste. 100
Shelby Township, MI 48316
Tel. 586-412-3350
Fax: 586-412-3305
WATS: 800-275-0046
detroit@brightonbest.com

Houston, TX
6911 Fairbanks N. Houston Rd. Ste. 150
Houston, TX 77040
Tel: 713-466-0336
Fax: 713-466-0385
WATS: 800-275-0054
houston@brightonbest.com

Logan Township, NJ
1222 Forest Pkwy.
West Deptford, NJ 08066
Tel. 856-241-9494
Fax: 856-241-9477
WATS: 800-935-2378
logan@brightonbest.com

Los Angeles, CA
12801 Leffingwell Ave.
Santa Fe Springs, CA 90670
Tel. 562-483-2740
Fax: 562-404-3999
WATS: 800-275-0028
losangeles@brightonbest.com

Miami, FL
3426 West 84th St., Ste. 203
Hialeah, FL 33018
Tel. 305-512-3446
Fax: 305-512-3450
WATS: 800-275-0035
miami@brightonbest.com

Nashville, TN
446 Metroplex Dr., Ste. A120
Nashville, TN 37211
Tel. 615-834-1154
Fax: 615-834-1157
WATS: 800-275-0029
nashville@brightonbest.com

Portland, OR
13440 NE Jarrett St.
Portland, OR 97230
Tel: 503-261-0660
Fax: 503-252-4093
WATS: 800-275-0686
portland@brightonbest.com

Rogers, MN
21010 Commerce Blvd.
Ste. B
Rogers, MN 55374
Tel. 763-425-9464
Fax: 763-425-9266
WATS: 800-275-0031
minnesota@brightonbest.com

Salt Lake City, UT
2179 S. Commerce Center Dr. Ste. 400
West Valley City, UT 84120
Tel: 801-972-1313
Fax: 801-972-5114
WATS: 800-935-1402
saltlake@brightonbest.com

Sayreville, NJ
200 Kennedy Dr.
Sayreville, NJ. 08872
Tel. 732-525-8400
Fax: 732-525-8408
sayreville@brightonbest.com

Seattle, WA
20308 59th Place South, Bldg. 1A
Kent, WA, 98032
Tel. 253-872-3417
Fax: 253-872-3415
WATS: 800-935-1502
seattle@brightonbest.com

St. Louis, MO
1856 Craig Rd.
St. Louis, MO 63146
Tel. 314-205-8001
Fax: 314-205-0857
WATS: 800-275-0047
stlouis@brightonbest.com

Tampa, FL
4915 Distribution Dr.
Tampa, FL 33605
Tel. 305-512-3446
Fax: 305-512-3450
WATS: 800-275-0035
tampa@brightonbest.com

CANADA

Montreal, Québec
5780 Kieran
Saint-Laurent, Québec H4S 2B5
Tel: 514-336-9888
Fax: 514-336-8865
WATS: 800-361-2076
montreal@brightonbest.com

Toronto, Ontario
7900 Goreway Dr., Unit 1
Brampton, Ontario L6T 5W6
Tel: 905-791-2000
Fax: 905-791-6841
WATS: 800-268-6918
toronto@brightonbest.com

Vancouver, British Columbia
9489 200 St, Unit 103&104
Langley, B.C. V1M 3A7
Tel: 604-513-0311
Fax: 604-513-0312
WATS: 800-663-9106
vancouver@brightonbest.com

U.K.

Birmingham, West Midlands
Fastener Complex D1
Cradley Business Park,
Overend Rd., Cradley Heath
West Midlands B64 7DW
Tel. +44 (0) 1384-568144
Fax: +44 (0) 1384-413719
sales@brightonbest.org

AUSTRALIA

Brisbane, Queensland
11 Stradbroke St.
Heathwood, Queensland 4110
Tel. 617-3727-5700
Fax: 617-3714-9821
qldsales@brightonbest.com.au

Melbourne, Victoria
31-33 Canterbury Rd.
Braeside, VIC 3195
Tel. 613-8586-0244
Fax: 613-9587-7255
vicsales@brightonbest.com.au

Perth, Western Australia
Unit 3/420 Victoria Rd.
Malaga, Western Australia 6090
Tel. 618-6240-6800
Fax: 618-9248-4766
wasales@brightonbest.com.au

Sydney, New South Wales
6 Shale Place
Eastern Creek, NSW 2766
Tel. 612-8818-0900
Fax: 612-9620-1050
nswsales@brightonbest.com.au

NEW ZEALAND

Auckland, New Zealand
28B Pavilion Dr. Airport Oaks
Mangere, Auckland 2022
Tel. 649-257-5256
Fax: 649-257-5328
nzsales@brightonbest.co.nz

BRAZIL

São Paulo, Brazil
Rua Dos Missionários, 410
São Paulo, Brazil 04729-001
Tel. 55 11-5641-4037
Fax: 55 11-5641-2444
luizab@brightonbest.com.br

MEXICO

Mexico
Toll Free: 1(855)-816-9726
Fax: 562-404-3999
mexico@brightonbest.com